



## SOUND LEVEL ASSESSMENT REPORT

---

### Hillman Energy Center Tewksbury, Massachusetts

*Prepared for:*

**East Point Energy, LLC**  
310 4<sup>th</sup> Street N.E.  
3<sup>rd</sup> Floor  
Charlottesville, VA 22902

*Prepared by:*



**Epsilon Associates, Inc.**  
3 Mill & Main Place, Suite 250  
Maynard, MA 01754

September 23, 2025

## TABLE OF CONTENTS

---

<b>1.0</b>	<b>EXECUTIVE SUMMARY</b>	<b>1-1</b>
<b>2.0</b>	<b>INTRODUCTION</b>	<b>2-1</b>
<b>3.0</b>	<b>SOUND TERMINOLOGY</b>	<b>3-1</b>
<b>4.0</b>	<b>NOISE REGULATIONS</b>	<b>4-1</b>
4.1	Federal Regulations	4-1
4.2	Massachusetts State Regulations	4-1
4.3	Tewksbury Local Regulations	4-2
<b>5.0</b>	<b>EXISTING SOUND LEVELS</b>	<b>5-1</b>
5.1	Baseline Sound Environment	5-1
5.2	Sound Level Measurement Locations	5-1
5.3	Measurement Methodology	5-4
5.4	Measurement Equipment	5-4
5.5	Baseline Ambient Sound Levels	5-4
5.5.1	Short-term Sound Levels	5-5
5.5.2	Long-term Sound Levels	5-6
5.5.3	Establishment of Ambient Sound Levels for Evaluations	5-7
<b>6.0</b>	<b>MODELED SOUND LEVELS</b>	<b>6-1</b>
6.1	Modeled Sound Sources	6-1
6.2	Modeling Methodology	6-1
6.3	Sound Modeling Results	6-4
<b>7.0</b>	<b>MITIGATION MEASURES</b>	<b>7-1</b>
7.1	Silenced Equipment	7-1
7.2	Sound Attenuation Barriers	7-1
7.3	Low Noise Substation Transformer	7-1
7.4	Operational Restrictions	7-1
<b>8.0</b>	<b>CONCLUSIONS</b>	<b>8-1</b>

## LIST OF APPENDICES

---

Appendix A	MassDEP Noise Pollution Policy Interpretation
Appendix B	Long-Term Sound Level Measurement Data

## LIST OF FIGURES

---

Figure 2-1	Aerial Locus	2-2
Figure 3-1	Common Indoor and Outdoor Sound Levels	3-3
Figure 5-1	Sound Monitoring Locations	5-3
Figure 6-1	Sound Level Modeling Locations	6-3
Figure 6-2	Sound Level Modeling Results – Daytime	6-12
Figure 6-3	Sound Level Modeling Results – Nighttime	6-13

## LIST OF TABLES

---

Table 4-1	Tewksbury Maximum Allowable Exterior Sound Level	4-2
Table 5-1	GPS Coordinates (WGS 84) – Sound Level Measurement Locations	5-2
Table 5-2	Daytime Short-Term Ambient Measurement Summary	5-5
Table 5-3	Nighttime Short-Term Ambient Measurement Summary	5-5
Table 5-4	Daytime <sup>1</sup> Background Sound Level Measurement Summary	5-6
Table 5-5	Nighttime <sup>1</sup> Background Sound Level Measurement Summary	5-6
Table 6-1	Summary of Sound Producing Equipment	6-1
Table 6-2	Reference Sound Power Level by Source (Proposed Equipment)	6-4
Table 6-3	Daytime <sup>1</sup> MassDEP Compliance Evaluation – Mitigated Case	6-6
Table 6-4	Nighttime <sup>1</sup> MassDEP Compliance Evaluation – Mitigated Case	6-7
Table 6-5	Daytime “Pure Tone” Evaluation of the MassDEP Noise Policy	6-8
Table 6-6	Nighttime “Pure Tone” Evaluation of the MassDEP Noise Policy	6-9
Table 6-7	Daytime <sup>1</sup> Tewksbury Compliance Evaluation – Mitigated Case	6-10
Table 6-8	Nighttime <sup>1</sup> Tewksbury Compliance Evaluation – Mitigated Case	6-11

## 1.0 EXECUTIVE SUMMARY

---

The Hillman Energy Center Project (the Project) is a proposed 125 megawatt (MW) battery energy storage facility consisting of battery energy storage systems and an electric substation on approximately 4 acres of land located at 73-75 Hillman Street in the Town of Tewksbury, Massachusetts. The proposed Project is being developed by East Point Energy, LLC (East Point). East Point has retained Epsilon Associates, Inc. (Epsilon) to conduct a pre-construction sound level assessment for the Project.

This sound level assessment includes an ambient sound level measurement program to document the existing conditions in the vicinity of the Project and computer modeling to predict sound levels from the proposed Project. Results from the measurement program and the modeling were used to evaluate compliance with the Massachusetts Department of Environmental Protection (MassDEP) Noise Policy which limits the increase over ambient to 10 dBA or less and prohibits creation of new 'pure tone' conditions. Modeling results were also compared to the Town of Tewksbury sound limits.

Existing condition sound levels were continuously measured for eight days at three locations around the site. Supplemental short-term measurements were also performed at three additional locations near the site during both a daytime and nighttime period. The eight-day average sound level using the lowest hourly  $L_{90}$  sound levels measured during each daytime and nighttime period of the program was used to establish representative daytime and nighttime background (ambient) sound levels at each location.

Noise controls necessary to meet the requirements of the MassDEP Noise Policy and the Town of Tewksbury sound limits were implemented and are discussed in this analysis. Mitigation was applied in the acoustic model including utilizing low noise equipment, equipment silencers and sound barriers. Nighttime charging restrictions required by the Independent System Operator – New England (ISONE) interconnection agreement result in fewer Project components operating during those time periods. Therefore, less equipment will be operational during nighttime as compared to daytime when the entire facility may be in operation.

At residential locations, predicted sound level increases range from 6 to 10 dBA above the nighttime ambient and range from 4 to 8 dBA above the daytime ambient. In addition, the Project is not predicted to create any new pure tones. Therefore, with the noise mitigation measures described in this report, or equivalent design changes, the proposed Project will meet the requirements set forth in the MassDEP Noise Policy at all residential locations. The predicted sound level increases are based on low ambient sound levels derived from the quietest nighttime and daytime hours. During the majority of time, background sound levels are expected to be higher than those assumed in this evaluation and the resulting sound level impacts will be less.

At all locations, predicted Project-Only sound levels will be at or below the respective Town of Tewksbury sound level limits. At Area Use II locations, predicted Project-Only sound levels are at or below 65 dBA and at Area Use I locations, predicted Project-Only sound levels are below 50 dBA during both daytime and nighttime. Therefore, with the noise mitigation measures described in this report, or equivalent design changes, the proposed Project will meet the Town of Tewksbury Bylaws with respect to sound.

## 2.0 INTRODUCTION

---

The Project Site is located at 73-75 Hillman Street in Tewksbury, Massachusetts. The Project Site is approximately 4 acres in size. As shown on the Town of Tewksbury's Assessor's map, the Project Site is composed of two parcels (Parcels 35-6 and 35-7, 73 Hillman Street and 75 Hillman Street, respectively). Figure 2-1 shows the locations of the Project Site over aerial imagery.

The proposed Project consists of a 125 megawatt (MW) standalone battery energy storage system (BESS), a new 115kV / 34.5kV electric substation (the Project Substation), and other associated site features.

The BESS will consist of 134 Hithium LX5015 units and 40 EPC Power M10 inverters located north of Hillman Street. The Hithium units will be equipped with sound mitigation kits and arranged throughout the site in a back-to-back orientation. The units will be spaced in compliance with the manufacturer's installation requirements. It is anticipated that each battery and inverter will be supported by concrete slabs and surrounded by crushed stone.

This report presents the findings of an ambient measurement program and a sound level modeling analysis for the Project. The Project components were modeled in CadnaA using sound data calculated by Epsilon or from the manufacturer (Hithium and EPC). The proposed substation was also included in the model. The results of this analysis are found within this report.



Hillman Energy Center Tewksbury, Massachusetts



Figure 2-1  
Aerial Locus

### 3.0 SOUND TERMINOLOGY

---

There are several ways in which sound levels are measured and quantified. All of them use the logarithmic decibel (dB) scale. The following information defines the sound level terminology used in this analysis.

The decibel scale is logarithmic to accommodate the wide range of sound intensities found in the environment. A property of the decibel scale is that the sound pressure levels of two or more separate sounds are not directly additive. For example, if a sound of 50 dB is added to another sound of 50 dB, the total is only a 3-decibel increase (53 dB), which is equal to doubling in sound energy, but not equal to a doubling in decibel quantity (100 dB). Thus, every 3-dB change in sound level represents a doubling or halving of sound energy. The human ear does not perceive changes in the sound pressure level as equal changes in loudness. Scientific research demonstrates that the following general relationships hold between sound level and human perception for two sound levels with the same or very similar frequency characteristics<sup>1</sup>:

- 3 dBA increase or decrease results in a change in sound that is just perceptible to the average person,
- 5 dBA increase or decrease is described as a clearly noticeable change in sound level, and
- 10 dBA increase or decrease is described as twice or half as loud.

Another mathematical property of decibels is that if one source of sound is at least 10 dB louder than another source, then the total sound level is simply the sound level of the higher-level source. For example, a sound source at 60 dB plus another sound source at 47 dB is equal to 60 dB.

A sound level meter (SLM) that is used to measure sound is a standardized instrument.<sup>2</sup> It contains “weighting networks” (e.g., A-, C-, Z-weightings) to adjust the frequency response of the instrument. Frequencies, reported in Hertz (Hz), are detailed characterizations of sounds, often addressed in musical terms as “pitch” or “tone”. The most commonly used weighting network is the A-weighting because it most closely approximates how the human ear responds to sound at various frequencies. The A-weighting network is the accepted scale used for community sound level measurements; therefore, sounds are frequently reported as detected with a sound level meter using this weighting. A-weighted sound levels emphasize middle frequency sounds (i.e., middle pitched – around 1,000 Hz), and de-emphasize low and high frequency sounds. These sound levels are reported in decibels designated as “dBA”. The C-weighting network has a nearly flat response for frequencies between 63 Hz and 4,000 Hz and is noted as dBC. Z-weighted sound levels are measured sound levels without any weighting curve and are otherwise referred to as

<sup>1</sup> Bies, David, and Colin Hansen. 2009. *Engineering Noise Control: Theory and Practice*, 4<sup>th</sup> Edition. New York: Taylor and Francis.

<sup>2</sup> *American National Standard Specification for Sound Level Meters*, ANSI S1.4-2014 (R2019), published by the Standards Secretariat of the Acoustical Society of America, Melville, NY.

“unweighted”. Sound pressure levels for some common indoor and outdoor environments are shown in Figure 3-1.


Because the sounds in our environment vary with time they cannot simply be described with a single number. Two methods are used for describing variable sounds. These are exceedance levels and the equivalent level, both of which are derived from some number of moment-to-moment A-weighted sound level measurements. Exceedance levels are values from the cumulative amplitude distribution of all of the sound levels observed during a measurement period. Exceedance levels are designated  $L_n$ , where  $n$  can have a value between 0 and 100 in terms of percentage. Several sound level metrics that are reported in community sound monitoring are described below.

- $L_{90}$  is the sound level exceeded 90 percent of the time during the measurement period. The  $L_{90}$  is close to the lowest sound level observed. It is essentially the same as the residual sound level, which is the sound level observed when there are no obvious nearby intermittent sound sources. The  $L_{90}$  level is used to establish the “ambient” or “background” sound level as part of the MassDEP Noise Policy.
- $L_{eq}$ , the equivalent level, is the level of a hypothetical steady sound that would have the same energy (*i.e.*, the same time-averaged mean square sound pressure) as the actual fluctuating sound observed. The equivalent level is designated  $L_{eq}$  and is typically A-weighted. The equivalent level represents the time average of the fluctuating sound pressure, but because sound is represented on a logarithmic scale and the averaging is done with linear mean square sound pressure values, the  $L_{eq}$  is mostly determined by loud sounds if there are fluctuating sound levels.

# COMMON INDOOR SOUNDS

Sound Pressure  
 Level, dBA

# COMMON OUTDOOR SOUNDS

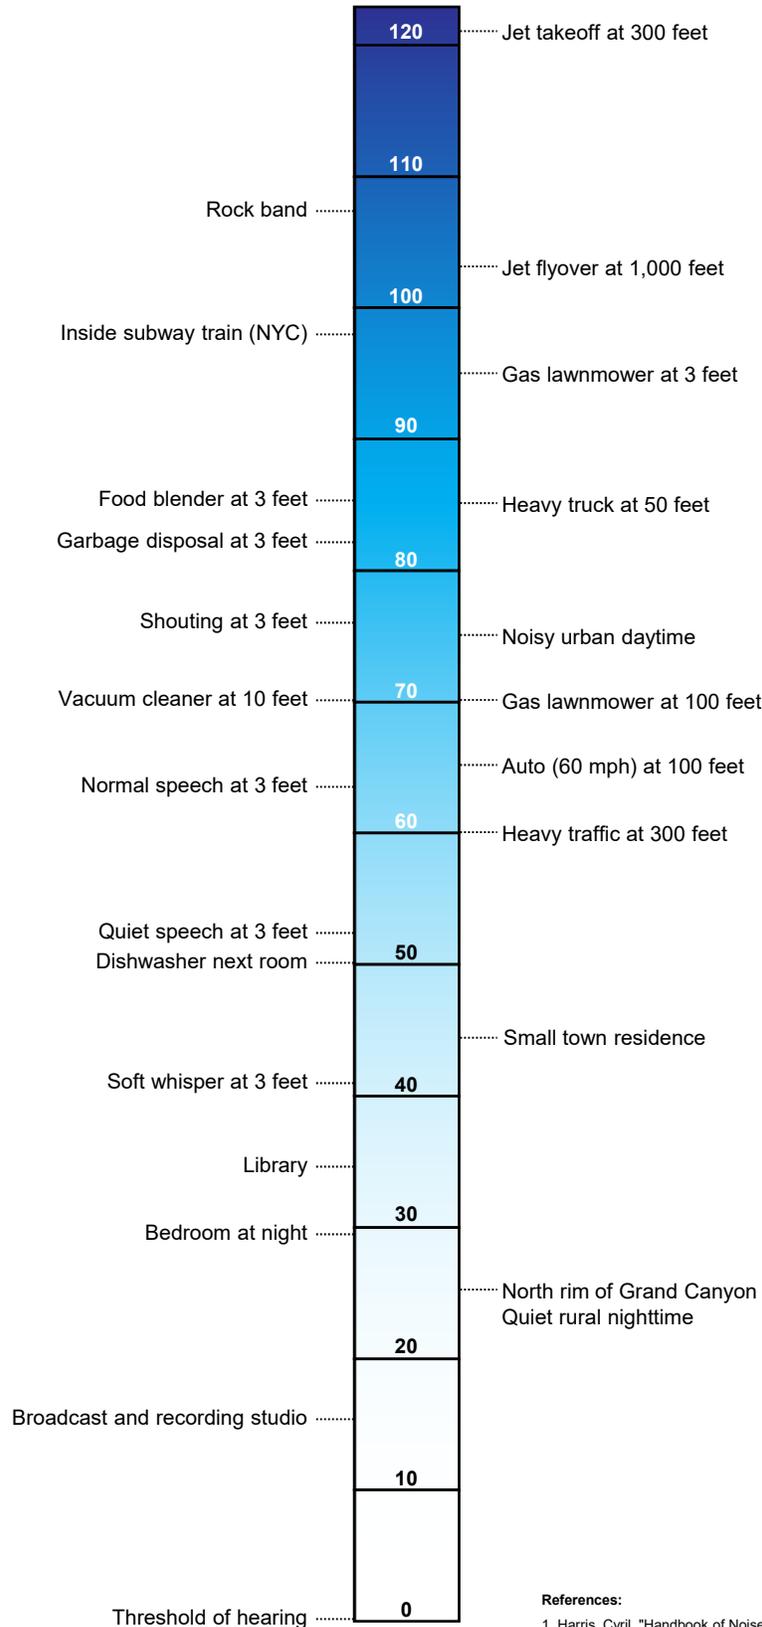

**References:**

- Harris, Cyril, "Handbook of Noise Acoustical Measurements and Noise Control", p 1-10., 1998
- "Controlling Noise", USAF, AFMC, AFDTIC, Elgin AFB, Fact Sheet, August 1996
- California Dept. of Trans., "Technical Noise Supplement", Oct, 1998

## 4.0 NOISE REGULATIONS

---

### 4.1 Federal Regulations

There are no federal community noise regulations applicable to this Project.

### 4.2 Massachusetts State Regulations

The Massachusetts Department of Environmental Protection (MassDEP) regulates noise under its Air Pollution Control regulations. In these regulations, an “air contaminant” is defined to include sound, and a condition of “air pollution” includes the presence of an air contaminant in such concentration and duration as to “cause a nuisance” or “unreasonably interfere with the comfortable enjoyment of life and property.” (310 CMR 7.00)

MassDEP’s regulations at 310 CMR 7.10 prohibit “unnecessary emissions” of noise. MassDEP Division of Air Quality Control (“DAQC”) Policy Statement 90-001 (February 1, 1990) (the “MassDEP Noise Policy”) interprets a violation of this noise regulation to have occurred if the source causes either:

- 1) An increase in the broadband sound pressure level of more than 10 dBA above the ambient, or
- 2) A “pure tone” condition.

“Ambient” is defined as the background A-weighted sound level that is exceeded 90% of the time, measured during equipment operating hours ( $L_{90}$ ). A “pure tone” condition occurs when any octave band sound pressure level exceeds both of the two adjacent octave band sound pressure levels by 3 dB or more.

These noise limits are MassDEP policy and are applicable both at the property line and at the nearest residences. As a policy and not regulation, the MassDEP has waived these limits in certain cases at property line locations where the adjacent land uses are not considered noise sensitive, such as an adjacent industrial parcel. According to the MassDEP, “Noise levels that exceed the criteria at the source’s property line by themselves do not necessarily result in a violation or a condition of air pollution under MassDEP regulations (see 310 CMR 7.10 U). The agency also considers the effect of noise on the nearest occupied residence and/or building housing sensitive receptors”. In addition, “...a new noise source that would be located in an area in which housing or buildings containing other sensitive receptors could be developed in the future may be required to mitigate its noise impact in these areas.” The Noise Policy interpretation is attached to this report as Appendix A.

### 4.3 Tewksbury Local Regulations

The Town of Tewksbury Bylaws Chapter 8.12.050 defines property line noise limits for continuous sources based on the receiving property classification in Table I. Maximum Allowable Exterior Sound Level, which is reproduced below, as Table 4-1. Additionally, Chapter 8.12.050 disallows pure tone conditions. Area I land uses are residential properties and the grounds of any school, day care, hospital, house of worship, library or cemetery. Area II land uses are all other properties.

**Table 4-1 Tewksbury Maximum Allowable Exterior Sound Level**

Land Use Area	Daytime Level 7:00 AM to 10:00 PM	Nighttime Level 10:00 PM to 7:00 AM
I	60 dBA	50 dBA
II	70 dBA	65 dBA

## 5.0 EXISTING SOUND LEVELS

---

The Project is to be located at 73-75 Hillman Street in Tewksbury, Massachusetts. The Project Site is in an existing industrial park. The property is bordered by industrial and commercial uses to the east and south, with an assisted living community further to the east and a few residences further to the south. The northern and western sides of the Project are bordered by uninhabited wetlands and utilities.

### 5.1 Baseline Sound Environment

An existing sound level survey was conducted during the daytime and nighttime hours to characterize the existing “baseline” acoustical environment in the vicinity of the site. Three long-term continuous sound level monitoring stations were deployed for 8-days to:

1. Establish representative A-weighted broadband ambient sound pressure levels, for evaluating requirements of the MassDEP policy limit of a 10 dBA increase due to the proposed Project; and
2. Establish representative octave-band ambient sound pressure levels to identify any existing “pure tones,” as defined by MassDEP, and evaluate whether the addition of modeled sound levels from the proposed Project to these background sound levels may introduce or exacerbate existing “pure tones” in the community.

Only measurement periods during, or affected by, precipitation were excluded from the analysis. This approach is consistent with ANSI Standard S12.18-1994 (R2009).

### 5.2 Sound Level Measurement Locations


The selection of the sound level measurement locations was based upon a review of the Project site plan and the land use in the vicinity of the Project. Three (3) long-term (LT) sound level measurement locations were selected to obtain a sampling of the baseline sound environment. These measurement locations were selected to be representative of the north and sound end of the Project parcel and the neighboring assisted living community to the east of the Project. In addition, three (3) short-term (ST) sound level measurements were performed at additional locations near the site. Coordinates of the monitoring locations are presented in Table 5-1. These measurement locations are depicted in Figure 5-1 and described below.

- **Location LT1** is located approximately 90 feet east of Washington Street and 150 feet west of the assisted living community. This location is representative of the closest residences in the assisted living community to the east of the Project.
- **Location LT2** is located near the southern property line of the Project parcel, on the road verge between the Project and Hillman Street. This location is representative of the industrial and commercial business to the south of the Project and the residences further to the south along Court Street.

- **Location LT3** is located near the northern property line of the Project parcel, 130 feet south of the railway which is located north of the project Parcel as well as north of the assisted living community. This location is representative of the northern part of the assisted living community to the far east of the Project.
- **Location ST1** is located to the east of the Project at the intersection of Hillman Street and Washington Street. This location is representative of the eastern portion of the industrial park and the assisted living community east of the Project.
- **Location ST2** is located to the south of the project, on the edge of Rockland Street along the electrical transmission lines. This location is representative of the residences to the south of the Project and along Court Street.
- **Location ST3** is located to the far southwest of the Project near the intersection of Main Street and Old Boston Road. This is representative of the residences to the far south of the Project along Old Boston Road, Washington Street and Main Street.

**Table 5-1 GPS Coordinates (WGS 84) – Sound Level Measurement Locations**

Location	Coordinates	
	Latitude (N°)	Longitude (W°)
LT1	42.618454	-71.241007
LT2	42.619754	-71.243179
LT3	42.621154	-71.242805
ST1	42.619570	-71.241389
ST2	42.618597	-71.243482
ST3	42.618376	-71.249701

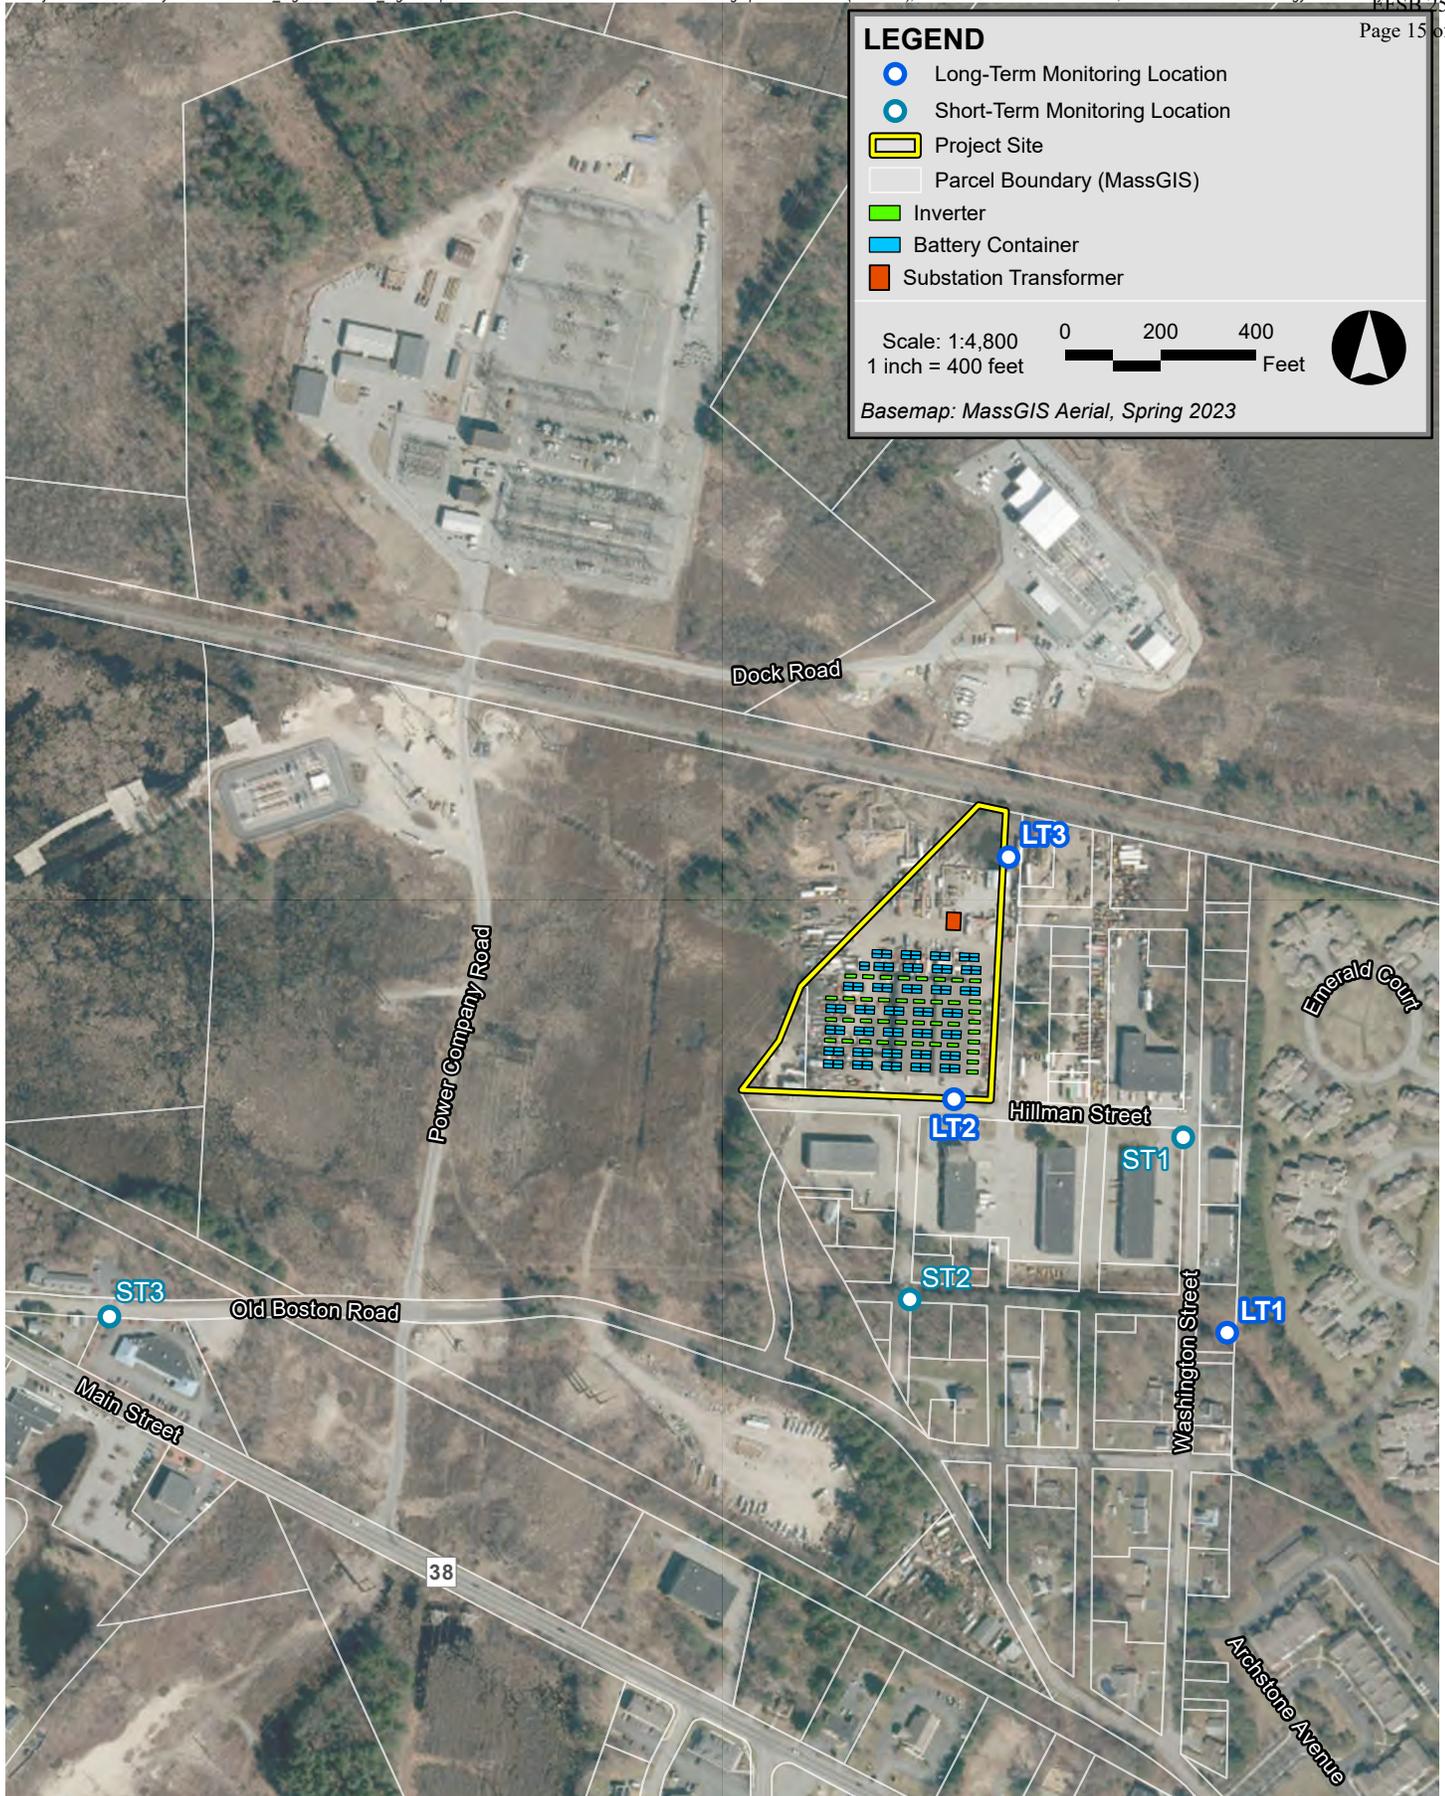

Hillman Energy Center Tewksbury, Massachusetts



Figure 5-1  
Sound Monitoring Locations

### **5.3 Measurement Methodology**

A comprehensive sound level measurement program was developed to quantify the existing ambient sound levels around the proposed Project. The program consisted of three long-term monitoring stations as well as three short-term monitoring stations. The long-term monitoring stations collected continuous sound level data for approximately eight days from Wednesday, February 26, 2025 to Thursday, March 6, 2025. The long-term monitors were generally unattended, with personal observations made by a field technician during deployment, a nighttime site visit, and demobilization. Short-term sound level measurements were made on Wednesday, February 26, 2025 during the daytime (2:11 p.m. to 3:32 p.m.) and on Thursday, February 27, 2025 during nighttime hours (12:13 a.m. to 1:27 a.m.). All short-term measurements were 20 minutes in duration.

### **5.4 Measurement Equipment**

Three Larson Davis (LD) 831 sound level meters, equipped with a LD PRM831 preamplifier and a PCB 377B02 or a PCB 377C20 half-inch microphone, along with an environmental protection kit were used to collect background sound pressure level data at the long-term measurement locations. The environmental protection kit included a manufacturer-provided wind screen to reduce wind-induced noise over the microphone. One LD 831 sound level meter, equipped with a PCB PRM831 preamplifier and a PCB 377C20 half-inch microphone, and a manufacturer-provided wind screen, was used to collect background sound pressure level data at the short-term measurement locations. Wind speed, wind direction, temperature, and precipitation measurements were made at LT1 using one, 2-meter above ground level (AGL), ATMOS 41 weather station and Z6 data logger (manufactured by Meter Group, Inc.).

All instrumentation meets the “Type 1 - Precision” requirements set forth in ANSI S1.4 for acoustical measuring devices. The measurement equipment was calibrated in the field before and after the survey with a Larson Davis CAL200 acoustical calibrator which meets the standards of IEC 942 Class 1L and ANSI S1.40. Statistical descriptors (e.g., Leq, L90, etc.) were measured for each sampling period (20-minutes for short-term and 1-hour for long-term) with octave band sound levels corresponding to the same datasets.

### **5.5 Baseline Ambient Sound Levels**

Current sound sources in the area surrounding the proposed project site include: industrial activity, chainsaws and other construction equipment, forklifts and dump trucks, idling trucks, backup alarms, vehicle traffic along local roads and distant major roads and highways, HVAC hum, substation noise, insects, birds, coyotes, wind through vegetation, and occasional aircraft.

**5.5.1 Short-term Sound Levels**

Summaries of the existing condition sound levels are shown in Tables 5-2 and 5-3 with measured daytime and nighttime sound levels from the short-term measurements, respectively. Daytime L<sub>90</sub> sound levels at the short-term locations ranged from 47 to 54 dBA and nighttime L<sub>90</sub> sound levels ranged from 40 to 43 dBA.

**Table 5-2 Daytime Short-Term Ambient Measurement Summary**

Location	Start Date & Time	L <sub>eq</sub> dBA	L <sub>90</sub> dBA	L <sub>90</sub> Sound Pressure Level by Octave-Band Center Frequency (Hz)									
				31.5	63	125	250	500	1000	2000	4000	8000	16000
				dB	dB	dB	dB	dB	dB	dB	dB	dB	dB
ST1	02/26/2025 2:11 PM	55	47	55	52	48	44	45	42	33	27	23	17
ST2	02/26/2025 2:38 PM	63	49	54	50	49	47	47	45	36	26	16	14
ST3	02/26/2025 3:12 PM	67	54	59	58	52	53	50	50	45	34	23	14

**Table 5-3 Nighttime Short-Term Ambient Measurement Summary**

Location	Start Date & Time	L <sub>eq</sub> dBA	L <sub>90</sub> dBA	L <sub>90</sub> Sound Pressure Level by Octave-Band Center Frequency (Hz)									
				31.5	63	125	250	500	1000	2000	4000	8000	16000
				dB	dB	dB	dB	dB	dB	dB	dB	dB	dB
ST1	02/27/2025 12:13 AM	44	43	50	54 <sup>1</sup>	44	38	42	39	31	21	11	17
ST2	02/27/2025 12:40 AM	52	40	44	40	42	39	40	33	21	12	11	14
ST3	02/27/2025 1:07 AM	47	41	51	49	44	42	40	34	23	15	12	14

1. An existing "pure-tone" condition was observed in the 63 Hz Octave Band at night at ST1.

### 5.5.2 Long-term Sound Levels

A-weighted broadband (dBA) and un-weighted octave-band (dB) background sound levels from the long-term locations are presented in Tables 5-4 and 5-5 for daytime (7AM – 9:59PM) and nighttime (10PM – 6:59AM) hours, respectively. Broadband L<sub>90</sub> values represent the average of the daily minimum L<sub>90</sub> sound pressure levels observed during the relevant daytime or nighttime operating periods throughout the measurement program. The octave-band values correspond to a representative time period where the broadband value equals the average of the daily/nightly minimum L<sub>90</sub> sound levels. There were a total of 24 hours with recorded precipitation during the 8-day program. These hours were excluded from further processing in accordance with ANSI S12.18.

One-hour A-weighted broadband sound pressure level data plots from the continuous ambient monitoring stations at locations LT1 through LT3 are presented in Appendix B for the entire measurement period. The average daily minimum L<sub>90</sub> (1-hour) sound levels ranged, by location, from 38 to 40 dBA during the day and from 34 to 37 dBA at night.

**Table 5-4 Daytime<sup>1</sup> Background Sound Level Measurement Summary**

Monitoring Location ID	L <sub>90</sub> <sup>2</sup> dBA	L <sub>90</sub> <sup>3</sup> Sound Pressure Level (dB) by Octave-Band (Hz)								
		31.5 Hz dB	63 Hz dB	125 Hz dB	250 Hz dB	500 Hz dB	1k Hz dB	2k Hz dB	4k Hz dB	8k Hz dB
		LT1	38	51	45	40	39	36	29	22
LT2	40	52	53	46	41	35	32	27	19	15
LT3	40	49	44	40	39	37	35	25	16	14

1. 'Daytime' defined to be between the operational hours of 7AM and 9:59PM.
2. Broadband L<sub>90</sub> represents the average of the minimum L<sub>90</sub> sound pressure levels observed each day of the measurement program during daytime hours.
3. Octave-band values correspond to a representative time period where the broadband value equals the average of the daily minimum L<sub>90</sub> sound levels.

**Table 5-5 Nighttime<sup>1</sup> Background Sound Level Measurement Summary**

Monitoring Location ID	L <sub>90</sub> <sup>2</sup> dBA	L <sub>90</sub> <sup>3</sup> Sound Pressure Level (dB) by Octave-Band (Hz)								
		31.5 Hz dB	63 Hz dB	125 Hz dB	250 Hz dB	500 Hz dB	1k Hz dB	2k Hz dB	4k Hz dB	8k Hz dB
		LT1	34	44	41	32	34	33	28	18
LT2	37	46	46	44	38	34	27	19	11	11
LT3	37	45	42	40	39	36	24	10	10	11

1. 'Nighttime' defined to be between the operational hours of 10PM and 7AM.
2. Broadband L<sub>90</sub> represents the average of the minimum L<sub>90</sub> sound pressure level observed each day of the measurement program during nighttime hours.
3. Octave-band values correspond to a representative time period where the broadband value equals the average of the nightly minimum L<sub>90</sub> sound levels.

### **5.5.3            *Establishment of Ambient Sound Levels for Evaluations***

The Project will be evaluated in this report against the MassDEP Noise Policy that is described in Section 4.2. As a result, ambient (background) sound levels must be established for each measurement location to then be applied to modeling receptors, i.e., evaluation points. The Project may operate at any time of the day or night, therefore the quietest representative daytime sound levels from the long-term measurements presented in Table 5-4 have been conservatively used in the evaluation for daytime operations and the quietest representative nighttime sound levels from the long-term measurements presented in Table 5-5 above have been conservatively used in the evaluation for nighttime operations. Each modeling receptor was evaluated based on the closest long-term measurement location. Assigned representative ambient sound levels and monitoring locations for each modeling receptor are provided in Section 6.

## 6.0 MODELED SOUND LEVELS

### 6.1 Modeled Sound Sources

The primary sources of sound associated with the Facility will consist of:

- Hithium LX5015 Battery Containers
- EPC Power M10 Inverters
- Substation power transformer

The Project expects to place 134 Hithium LX5015 Containers and 40 EPC Power M10 Inverters on the site. The substation associated with the Project will include one 150 MVA 115 kV transformer. Table 6-1 summarizes the sound-producing equipment list for the Project.

**Table 6-1 Summary of Sound Producing Equipment**

Component	Manufacturer/model	Quantity
Hithium LX5015	Hithium	134
M10 Inverter	EPC Power	40
Power transformer (150 MVA)	TBD	1

### 6.2 Modeling Methodology

Noise impacts from mechanical equipment associated with the Facility were predicted using CadnaA noise calculation software (DataKustik Corporation, Version 2025). This software, which uses the ISO 9613-2 international standard for sound propagation (Acoustics - Attenuation of sound during propagation outdoors - Part 2: Engineering method for the prediction of sound pressure levels outdoors [2024]), offers a refined set of computations accounting for local topography, ground attenuation, drop-off with distance, barrier shielding, diffraction around building edges, reflection off building facades, and atmospheric absorption of sound from multiple noise sources.


Inputs and significant parameters included in the model are described below:

- **Facility Layout:** The location of all proposed equipment was provided by East Point in a Site Plan drawing dated September 12, 2025.
- **Sensitive Receptors:** Sound levels were evaluated at seventeen (17) sensitive locations, including the nearest residential property lines and additional surrounding residences. Additionally, the directly abutting property lines were evaluated. The locations are shown in Figure 6-1. All receptors were modeled at a height of 1.5 meters above ground level to mimic the ears of a typical standing observer.

- **Terrain Elevation:** Elevation contours for the modeling domain derived from datasets supplied East Point Energy for the Project Site and by MassGIS for the surrounding area were directly imported into CadnaA, which allowed for consideration of terrain shielding and differences in elevation between sources and receivers, where appropriate.
- **Buildings:** Nearby buildings derived from datasets supplied by MassGIS with heights calculated from DSM elevations were imported into CadnaA, which allowed for consideration of shielding between sources and receivers, where appropriate. Within the area, 5 nearby industrial buildings were modeled, which represents the closest buildings to the Project.
- **Source Sound Power Levels:** A tabular summary of the modeled equipment proposed for the Facility and sound power levels for each unit, as provided by the manufacturer or calculated from NEMA ratings, are presented below in Table 6-2. Octave band data for the Hithium LX5015 battery storage container and M10 inverter were provided to Epsilon. Octave band data for the power transformer were not provided; thus, were calculated based on the Edison Electric Institute Environmental Noise Guide.
- **Meteorological Conditions:** A temperature of 10°C (50°F) and a relative humidity of 70% were assumed in the model to minimize atmospheric attenuation in the 500 Hz and 1 kHz octave-bands where the human ear is most sensitive.
- **Ground Attenuation:** Spectral ground absorption was calculated using a G-factor of 0 to represent reflective surfaces (i.e., gravel, pavement) for the BESS site and a G-factor of 0.5 for the surrounding area to represent mixed ground.

Several modeling assumptions inherent in the ISO 9613-2 calculation methodology, or selected as conditional inputs by Epsilon, were implemented in the CadnaA model to ensure conservative results (i.e., higher sound levels), and are described below:

- All modeled sources were assumed to be operating simultaneously and the corresponding to the greatest expected operational sound level impacts. A 2 dBA uncertainty was added to all modeled sound sources.
- Per ISO 9613-2, the model assumed favorable conditions for sound propagation, corresponding to a moderate, well-developed ground-based temperature inversion, as might occur on a calm, clear night or equivalently downwind propagation.
- Meteorological conditions assumed in the model (T=10°C/RH=70%) were selected to minimize atmospheric attenuation in the 500 Hz and 1 kHz octave bands where the human ear is most sensitive.
- No additional attenuation due to air turbulence, foliage, or wind shadow effects was considered in the model.

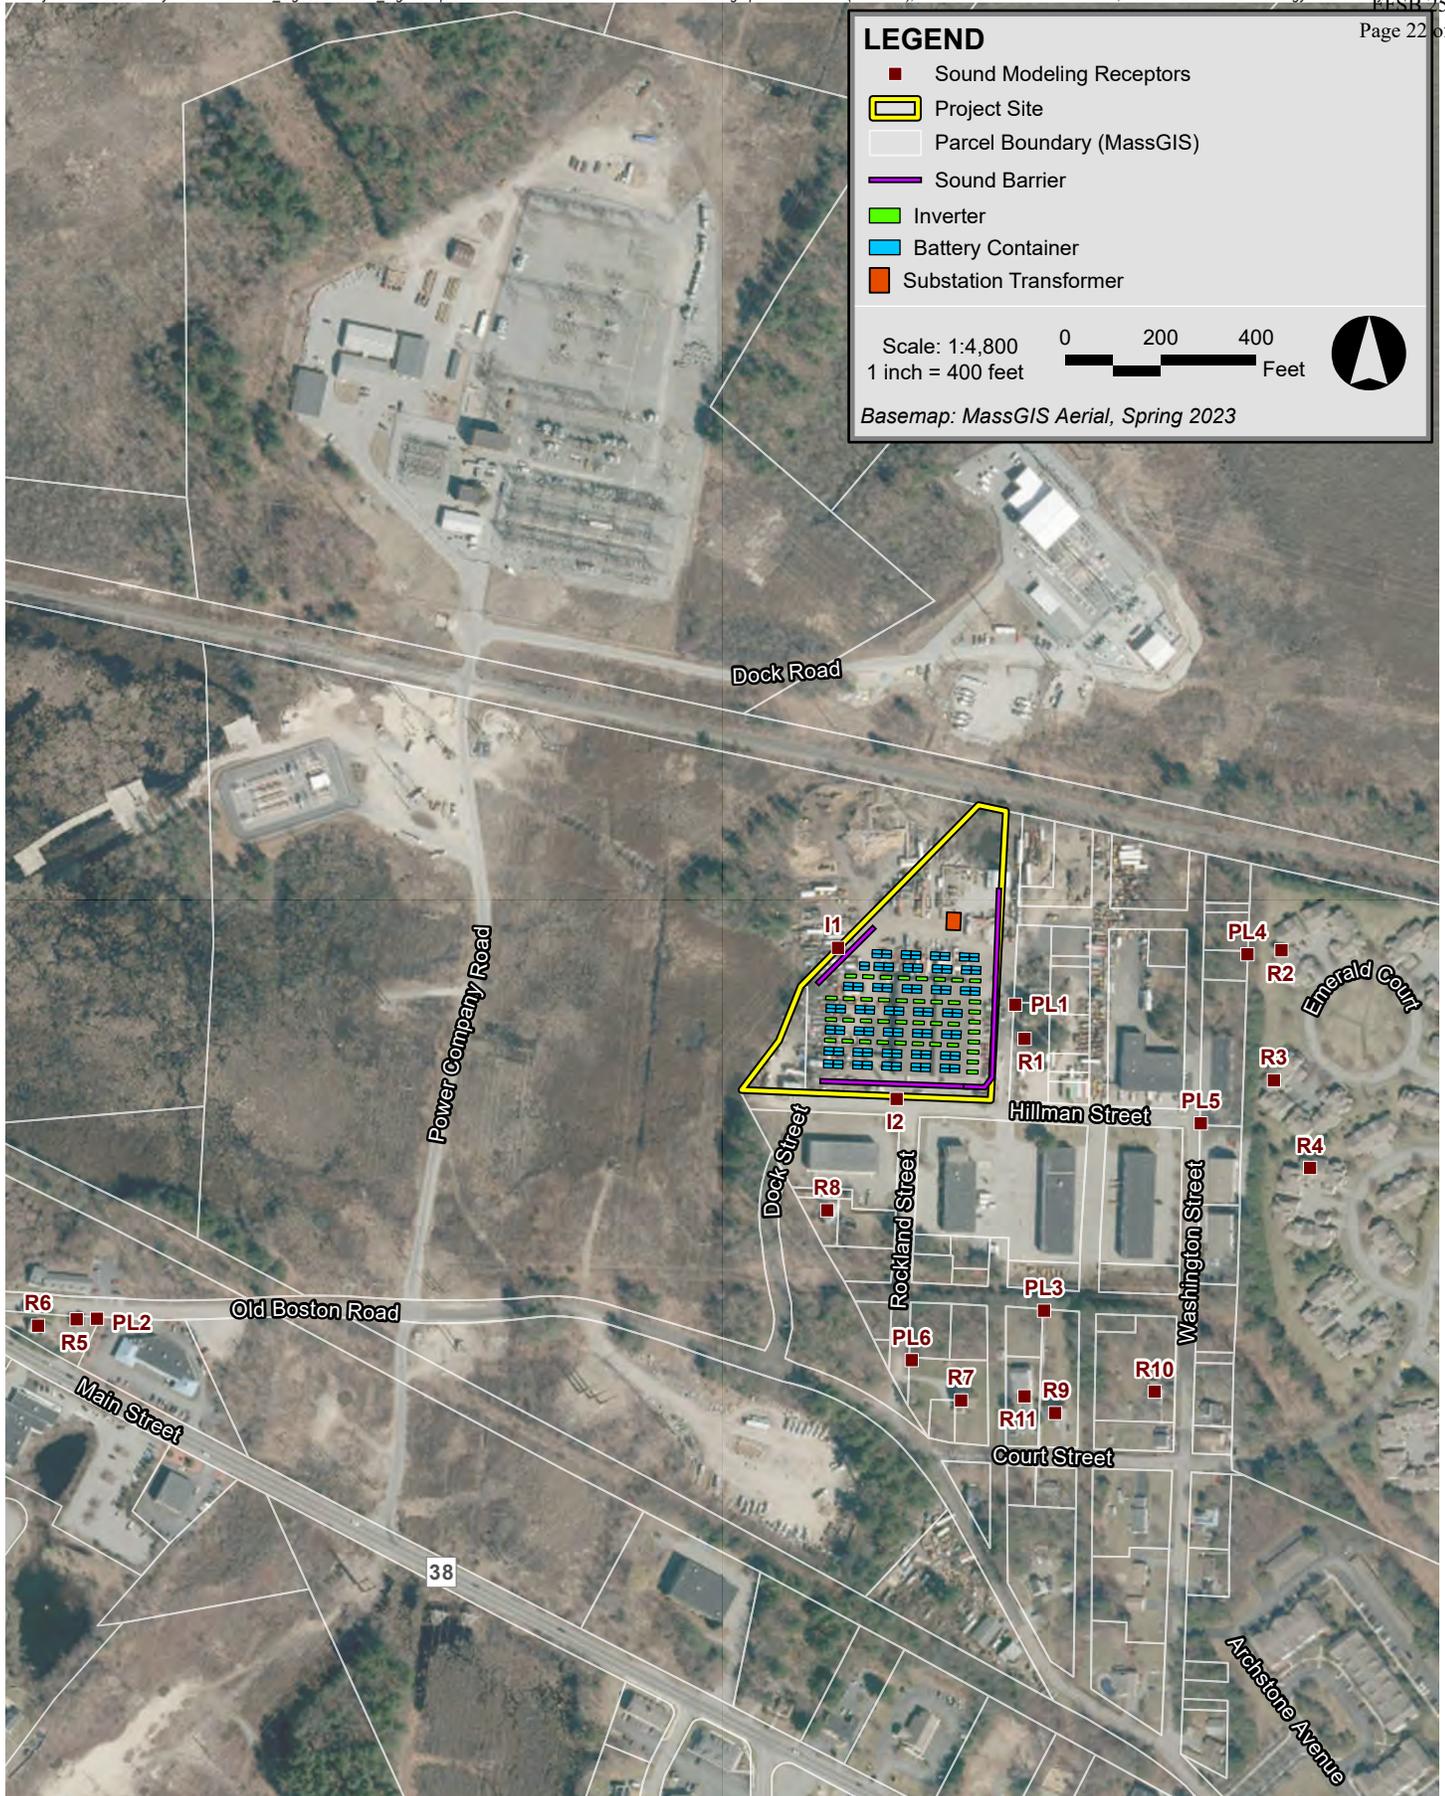

Hillman Energy Center Tewksbury, Massachusetts



Figure 6-1  
Sound Level Modeling Locations

**Table 6-2 Reference Sound Power Level by Source (Proposed Equipment)**

Proposed Source	Broadband Sound Power Level per Unit	Sound Level per Unit (dB) by Octave Band (Hz)								
		31.5	63	125	250	500	1k	2k	4k	8k
		dBA	dB	dB	dB	dB	dB	dB	dB	dB
Hithium LX5015 with 1.5m Noise Reduction Kit @ 95% fan speed	84 <sup>1</sup>	93 <sup>2</sup>	93	91	82	79	80	75	66	65
EPC Power M10 Inverter	CONFIDENTIAL <sup>3</sup>	CONFIDENTIAL								
150 MVA 115 kV Power Transformer	95 <sup>4</sup>	92	98	100	95	95	89	84	79	72

1. Sound power level per Hithium LX5015 container, with fan speeds at 95% and manufacturer specified 1.5m noise mitigation kit.
2. 31.5 Hz octave band sound power assumed to be the same as the 63 Hz octave band sound power
3. Sound power level per M10 unit, low noise system.
4. Broadband and octave band data for power transformer calculated from Electric Power Plant Environmental Noise Guide, Edison Electric Institute, 2<sup>nd</sup> edition, 1984. Assumes National Electrical Manufacturers Association (NEMA) rating of 71 dBA.

### 6.3 Sound Modeling Results

Table 6-3 presents a daytime evaluation of broadband sound levels at all modeling receptors and Table 6-4 presents a nighttime evaluation of broadband sound levels at all modeling receptors. Ambient L<sub>90</sub> sound levels shown in the table were assigned to each modeling location. Modeled Project-only broadband L<sub>eq</sub> sound levels are provided in the table. The ambient sound levels are logarithmically added to the modeled sound levels to determine a worst-case total broadband sound level for each modeling location. The total sound levels have been compared to the representative ambient L<sub>90</sub> sound levels for evaluation. With the noise control features described in Section 7, modeled future sound levels from the project are predicted to increase the background (ambient) L<sub>90</sub> sound levels by no more than 8 dBA during the daytime and 10 dBA during the nighttime at all residential receptor locations. Figure 6-2 presents the Project-only sound level contours for the facility operating at full capacity during the daytime and Figure 6-3 presents the Project-only sound level contours for the facility operating at reduced nighttime capacity.

The highest daytime 8 dBA increase occurs at two residential property lines to the south and east of the Project and one residence east of the Project. Closer residential areas to the south are shielded by industrial buildings. At all other residential locations, increases are predicted to be 7 dBA or less.

The highest nighttime 10 dBA increase occurs at two residential property lines to the south and east of the Project and one residence east of the Project. Closer residential areas to the south are

shielded by industrial buildings. At all other residential locations, increases are predicted to be 9 dBA or less.

The predicted sound level increases are based on low ambient sound levels derived from the quietest daytime and nighttime hours. During the majority of the time, background sound levels are expected to be higher than those assumed in this evaluation and the resulting sound level impacts will be less.

Octave-band sound pressure level modeling indicates that the proposed Project would not be anticipated to create any “pure-tone” conditions, as defined by MassDEP, when combined with existing ambient sound levels at any modeled receptor locations. A daytime pure tone evaluation is presented in Table 6-5 and a nighttime pure tone evaluation is presented in Table 6-6.

Modeled Project only sound levels have also been compared to the most restrictive Town of Tewksbury nighttime sound level limits in Table 6-7 for all receptors. As seen in Figure 6-2, the 50 dBA sound contour does not encroach on residential property and the 65 dBA contour is completely contained within the Project Boundary even during daytime full operation. Project only sound levels are at or below the respective nighttime noise limit based on use Area for all modeled receptor locations. With the noise control features described in Section 7, all Project-Only sound levels will comply with the Town of Tewksbury Bylaws with respect to sound.

**Table 6-3 Daytime<sup>1</sup> MassDEP Compliance Evaluation – Mitigated Case**

Receptor ID	Land Use	Representative Long Term Sound Level Measurement Location	Measured Background Noise Level	Modeled Facility-Only Noise Level (Proposed)	Combined Facility + Background Noise Level	Increase Above Background <sup>2</sup>	Meets MassDEP Limit?
			dB(A)	dB(A)	dB(A)	dB(A)	
R1	Residence	2	40	48	48	8	Yes
R2	Residence	1	38	42	43	5	Yes
R3	Residence	1	38	40	42	4	Yes
R4	Residence	1	38	43	44	6	Yes
R5	Residence	2	40	44	45	5	Yes
R6	Residence	2	40	44	45	5	Yes
R7	Residence	2	40	46	47	7	Yes
R8	Residence	2	40	43	45	4	Yes
R9	Residence	2	40	45	46	6	Yes
R10	Residence	1	38	43	44	6	Yes
R11	Residence	2	40	45	47	6	Yes
PL1	Property Line	2	40	48	49	8	Yes
PL2	Property Line	2	40	44	46	5	Yes
PL3	Property Line	2	40	47	48	7	Yes
PL4	Property Line	1	38	42	44	5	Yes
PL5	Property Line	1	38	44	45	7	Yes
PL6	Property Line	2	40	48	49	8	Yes
I1	Industrial	3	40	57	57	18	N/A
I2	Industrial	2	40	53	53	13	N/A

1. 'Daytime' defined as the operational hours between 7 AM and 10 PM

2. 'Increase Above Background' calculated from levels with greater precision than shown in this table, and then rounded to the nearest whole decibel.

**Table 6-4 Nighttime<sup>1</sup> MassDEP Compliance Evaluation – Mitigated Case**

Receptor ID	Land Use	Representative Long Term Sound Level Measurement Location	Measured Background Noise Level	Modeled Facility-Only Noise Level (Proposed)	Combined Facility + Background Noise Level	Increase Above Background <sup>2</sup>	Meets MassDEP Limit?
			dBa	dBa	dBa	dBa	
R1	Residence	2	37	47	47	10	Yes
R2	Residence	1	34	41	42	8	Yes
R3	Residence	1	34	39	40	6	Yes
R4	Residence	1	34	42	43	8	Yes
R5	Residence	2	37	43	44	7	Yes
R6	Residence	2	37	43	44	7	Yes
R7	Residence	2	37	46	46	9	Yes
R8	Residence	2	37	42	43	6	Yes
R9	Residence	2	37	44	45	8	Yes
R10	Residence	1	34	42	43	9	Yes
R11	Residence	2	37	44	45	8	Yes
PL1	Property Line	2	37	46	46	9	Yes
PL2	Property Line	2	37	43	44	7	Yes
PL3	Property Line	2	37	45	46	9	Yes
PL4	Property Line	1	34	41	42	8	Yes
PL5	Property Line	1	34	44	44	10	Yes
PL6	Property Line	2	37	47	47	10	Yes
I1	Industrial	3	37	57	57	20	N/A
I2	Industrial	2	37	52	52	16	N/A

1. 'Nighttime' defined as the operational hours between 10 PM and 7 AM

2. 'Increase Above Background' calculated from levels with greater precision than shown in this table, and then rounded to the nearest whole decibel.

**Table 6-5 Daytime “Pure Tone” Evaluation of the MassDEP Noise Policy**

Receptor ID	Land Use	Sound Level (dB) per Octave-Band Center Frequency (Hz) <sup>1</sup>								
		31.5	63	125	250	500	1k	2k	4k	8k
R1	Residence	64	62	57	47	46	42	38	28	19
R2	Residence	58	57	52	43	41	37	29	21	19
R3	Residence	58	56	51	41	40	35	28	21	19
R4	Residence	58	57	52	43	42	38	30	21	19
R5	Residence	57	58	51	43	43	41	34	20	15
R6	Residence	57	57	51	43	43	40	34	20	15
R7	Residence	59	59	54	45	45	42	37	23	15
R8	Residence	61	60	54	44	42	37	31	20	15
R9	Residence	59	59	54	45	44	41	35	22	15
R10	Residence	58	57	52	43	42	38	30	21	19
R11	Residence	59	59	54	45	44	41	35	22	15
PL1	Residence	64	62	57	47	46	42	38	29	21
PL2	Residence	57	58	51	43	43	41	34	20	15
PL3	Residence	60	60	55	46	44	43	37	23	15
PL4	Residence	59	58	52	43	41	37	29	21	19
PL5	Residence	59	58	52	43	42	40	33	22	19
PL6	Residence	60	60	55	46	46	44	39	25	15
I1	Industrial	69	69	66	57	56	51	44	32	23
I2	Industrial	69	67	63	52	51	46	39	29	22

1. Calculated from levels with greater precision than shown in this table, and then rounded to the nearest whole decibel.

**Table 6-6 Nighttime “Pure Tone” Evaluation of the MassDEP Noise Policy**

Receptor ID	Land Use	Sound Level (dB) per Octave-Band Center Frequency (Hz) <sup>1</sup>								
		31.5	63	125	250	500	1k	2k	4k	8k
R1	Residence	62	60	56	45	44	41	36	26	17
R2	Residence	57	56	51	41	40	36	28	14	11
R3	Residence	57	55	50	39	38	34	27	13	11
R4	Residence	56	56	51	41	41	37	30	14	11
R5	Residence	55	55	50	42	42	39	32	14	11
R6	Residence	55	55	49	41	42	39	32	13	11
R7	Residence	58	58	53	44	44	41	35	20	11
R8	Residence	60	59	53	43	41	35	28	15	11
R9	Residence	57	57	52	43	43	39	33	18	11
R10	Residence	56	56	51	41	41	37	30	14	11
R11	Residence	57	57	53	44	43	40	34	18	11
PL1	Residence	62	60	55	45	44	39	35	26	17
PL2	Residence	56	56	50	42	42	39	33	14	11
PL3	Residence	58	58	53	44	43	41	35	20	11
PL4	Residence	57	57	51	41	40	36	28	14	11
PL5	Residence	58	57	52	42	41	40	33	19	11
PL6	Residence	58	58	54	45	45	43	37	22	11
I1	Industrial	69	68	65	56	56	50	43	31	22
I2	Industrial	68	67	63	52	50	45	38	28	22

1. Calculated from levels with greater precision than shown in this table, and then rounded to the nearest whole decibel.

**Table 6-7 Daytime<sup>1</sup> Tewksbury Compliance Evaluation – Mitigated Case**


Receptor ID	Land Use Area	Modeled Facility-Only Noise Level (Proposed)	Tewksbury Use Area Noise Limit	Meets Tewksbury Limit?
		dBA	dBA	
R1	I	48	60	Yes
R2	I	42	60	Yes
R3	I	40	60	Yes
R4	I	43	60	Yes
R5	I	44	60	Yes
R6	I	44	60	Yes
R7	I	46	60	Yes
R8	I	43	60	Yes
R9	I	45	60	Yes
R10	I	43	60	Yes
R11	I	45	60	Yes
PL1	I	48	60	Yes
PL2	I	44	60	Yes
PL3	I	47	60	Yes
PL4	I	42	60	Yes
PL5	I	44	60	Yes
PL6	I	48	60	Yes
I1	II	57	70	Yes
I2	II	53	70	Yes

1. 'Daytime' defined as the operational hours between 7 AM and 10 PM

**Table 6-8 Nighttime<sup>1</sup> Tewksbury Compliance Evaluation – Mitigated Case**

Receptor ID	Land Use Area	Modeled Facility-Only Noise Level (Proposed)	Tewksbury Use Area Noise Limit	Meets Tewksbury Limit?
		dBA	dBA	
R1	I	47	50	Yes
R2	I	41	50	Yes
R3	I	39	50	Yes
R4	I	42	50	Yes
R5	I	43	50	Yes
R6	I	43	50	Yes
R7	I	46	50	Yes
R8	I	42	50	Yes
R9	I	44	50	Yes
R10	I	42	50	Yes
R11	I	44	50	Yes
PL1	I	46	50	Yes
PL2	I	43	50	Yes
PL3	I	45	50	Yes
PL4	I	41	50	Yes
PL5	I	44	50	Yes
PL6	I	47	50	Yes
I1	II	57	65	Yes
I2	II	52	65	Yes


1. 'Nighttime' defined as the operational hours between 10 PM and 7 AM

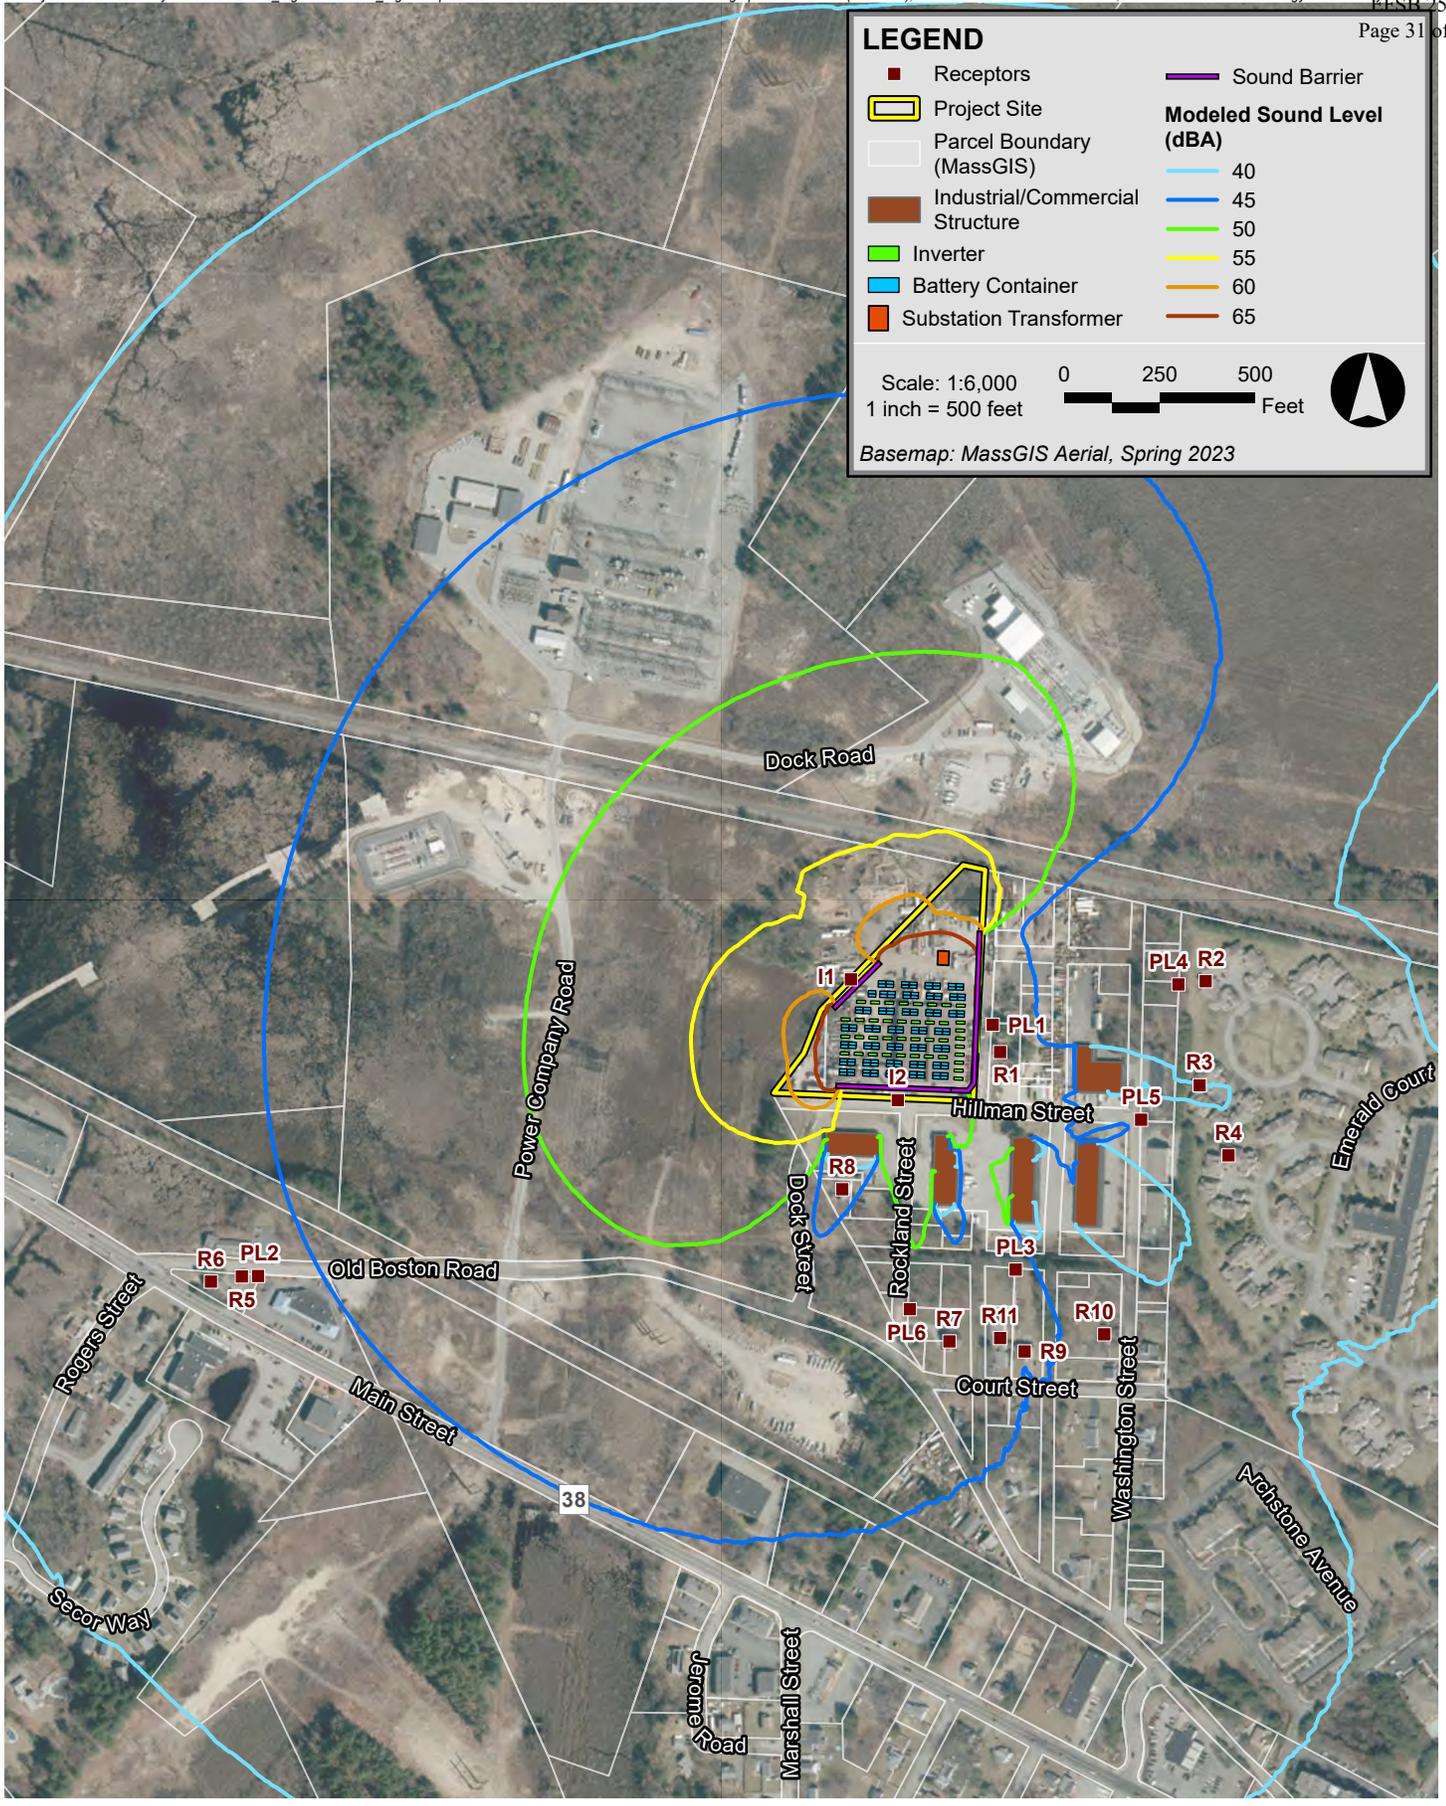

Hillman Energy Center LLC Tewksbury, Massachusetts



Figure 6-2  
Sound Level Modeling Results - Daytime

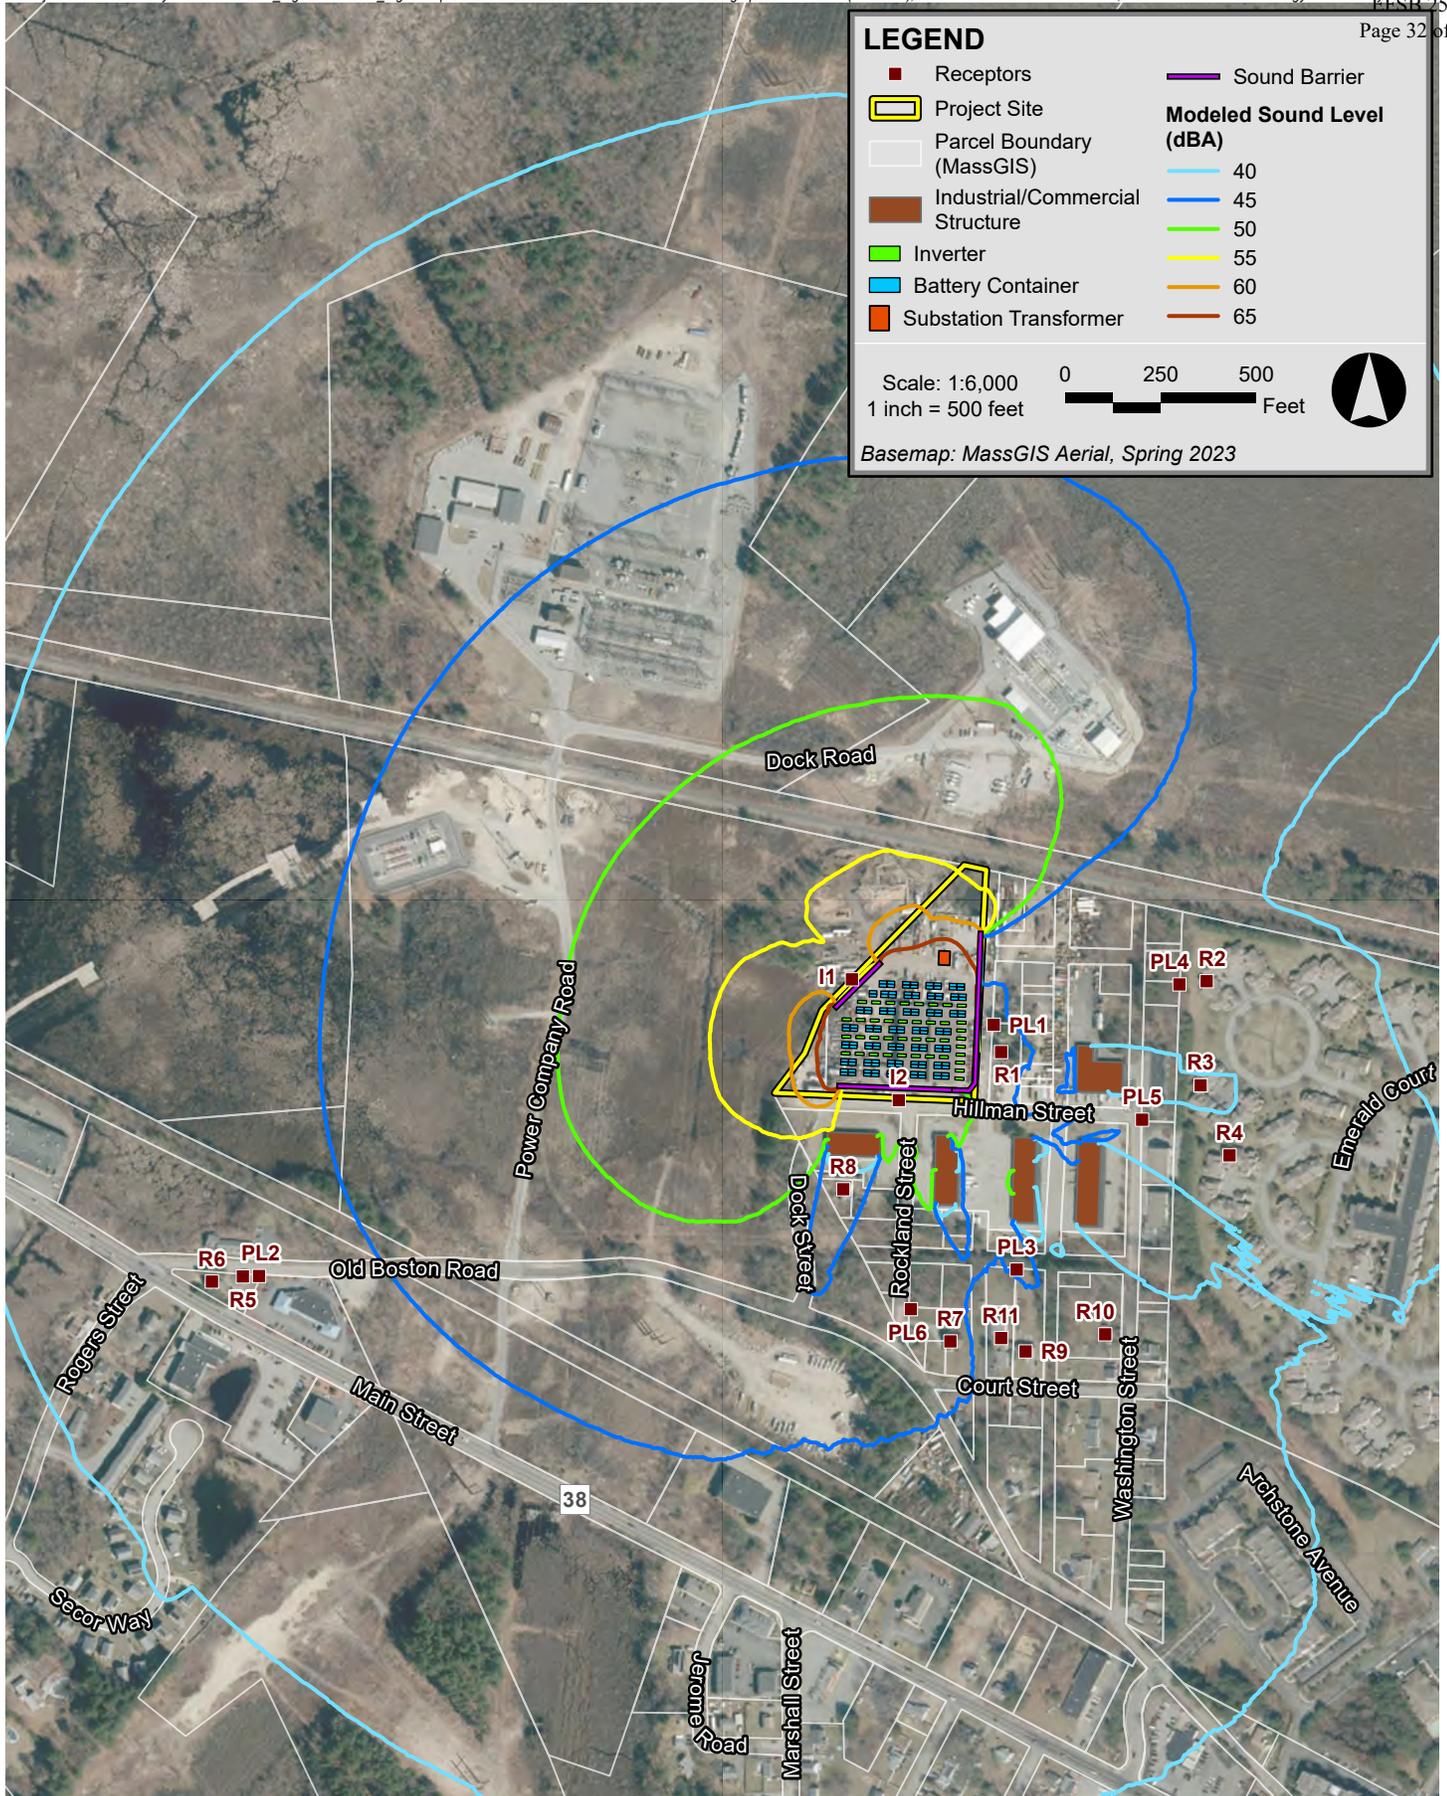

Hillman Energy Center LLC Tewksbury, Massachusetts



Figure 6-3  
 Sound Level Modeling Results - Nighttime

## **7.0 MITIGATION MEASURES**

---

### **7.1 Silenced Equipment**

The manufacturers for the proposed battery containers offer noise mitigation kits to mitigate the sound produced by the units. The Project will utilize the manufacturer specified 1.5m noise mitigation kit on all Hithium LX5015 units to reduce the sound produced by the battery containers.

The manufacturers for the proposed inverters offer a low acoustic system package to mitigate the sound produced by the units. The Project will utilize the manufacturer specified acoustic dampening package equipment on all M10 units to reduce the sound produced by the inverters.

### **7.2 Sound Attenuation Barriers**

In addition to silencing the battery container units and the inverters, the Project will also utilize sound attenuation barriers along the east, south, and northwest of the site. Under current design, a 30-foot-tall barrier along the east of the Project, an 18-foot-tall barrier along the southern side of each parcel of the Project, and a 10-foot-tall barrier along the northwest of the Project will be constructed. The barriers will be constructed of materials with adequate thickness and density to provide appropriate sound level reductions. The eastern and southern barriers will have an absorptive inner face corresponding to an absorption coefficient of at least 0.84. The proposed barrier locations, shown in Figures 6-1, 6-2, and 6-3, are situated as close as possible to the equipment while maintaining adequate ventilation and accessibility. Egress areas in the barriers will be designed to achieve adequate transmission loss approximately equivalent to the barrier itself. The contractor selected would be responsible for the design, detailing, and adequacy of the framework, supports, and attachment methods required for the proper construction of the sound attenuation barriers.

### **7.3 Low Noise Substation Transformer**

The Project will utilize a low noise power transformer at the substation. The proposed substation will feature one 150 MVA transformer. As described in Section 6.2, Epsilon estimated the octave band sound power levels of the transformer using methods outlined in the Electric Power Plant Environmental Noise guide (EEI Noise Guide) assuming the transformer will have a National Electrical Manufacturers Association (NEMA) noise rating of 71 dBA.

### **7.4 Operational Restrictions**

The Project is required by ISONE to only charge up to 100 MW of the Project at any given time. This corresponds with 80% of the facility being operational during charging periods. It is assumed that the charging will happen during the quietest times of the night and the other 20% of the facility will produce no sound during this time. This results in the operation of 108 of the Hithium LX5015 battery containers and 32 of the M10 inverters.

## **8.0 CONCLUSIONS**

---

A comprehensive sound level assessment has been conducted for the proposed Project. Substantial noise mitigation measures have been incorporated into the design of the proposed Project to minimize noise impacts in the community. These mitigation measures include low noise equipment, equipment silencers, and sound attenuation barriers. Results of a complete sound level assessment demonstrate that the sound levels from the facility will comply with the requirements set forth in the MassDEP Noise Policy at all residential locations as well as the Town of Tewksbury Bylaws.

**Appendix A**

---

**MassDEP Noise Pollution Policy Interpretation**



## Department of Environmental Protection

One Winter Street Boston, MA 02108 • 617-292-5500

### Noise Pollution Policy Interpretation

Noise is a public health concern that falls within the scope of Massachusetts Department of Environmental Protection (MassDEP) authority as a form of regulated air pollution. See the related law, regulations, and policy: [M.G.L. Chapter 111, Sections 142A-M](#), [310 CMR 7.00: Air Pollution Control](#), and [MassDEP Noise Policy](#)

#### Definitions (310 CMR 7.00)

- *Noise* is defined as "sound of sufficient intensity and/or duration as to cause a condition of air pollution."
- *Air pollution* means "the presence in the ambient air space of one or more air contaminants or combinations thereof in such concentrations and of such duration as to: (a) cause a nuisance; (b) be injurious, or be on the basis of current information, potentially injurious to human health or animal life, to vegetation, or to property; or (c) unreasonably interfere with the comfortable enjoyment of life and property or the conduct of business."

#### When Does MassDEP Evaluate Noise Impacts?

MassDEP evaluates how noise may affect people when 1) the agency reviews applications for approval under its air pollution regulations (310 CMR 7.02) for construction of facilities that will generate more than threshold amounts of pollutants such as nitrogen dioxide, sulfur dioxide, carbon monoxide, volatile organic compounds, particulate matter, and substances that are toxic in air; and 2) the agency responds to complaints from the public about noise generated by an existing source:

- When reviewing applications for pre-construction approval of new sources of air pollution, MassDEP examines the potential increase in sound levels over ambient conditions and the impacts of noise at both the source's property line and at the nearest residence or other sensitive receptor (e.g., schools, hospitals) located in the area surrounding the facility and occupied at the time of the permit review. *Please note: MassDEP requires that an air approval be obtained when a proposed facility is expected to emit more than threshold amounts of specific pollutants. If noise is the only air pollutant expected to be emitted by a facility, a pre-construction air approval is not required.*
- When MassDEP responds to a complaint about an existing source of noise, it focuses on protecting affected people at their residences and in other buildings that are occupied by sensitive receptors from nuisances and the public health effects of the noise. *Please note: An existing source of sound may or may not have needed a MassDEP air approval before it was built.*

## **Where Are MassDEP's Noise Criteria Applied?**

The MassDEP noise pollution policy describes criteria that MassDEP uses to evaluate noise impacts at both the property line and the nearest occupied residence or other sensitive receptor. When noise is found to be a nuisance or a threat to health, MassDEP requires the source to mitigate its noise.

Noise levels that exceed the criteria at the source's property line by themselves do not necessarily result in a violation or a condition of air pollution under MassDEP regulations (see 310 CMR 7.10 U). The agency also considers the effect of noise on the nearest occupied residence and/or building housing sensitive receptors:

- In responding to complaints, MassDEP measures noise levels at the complainant's location and at other nearby locations that may be affected (e.g., residences and/or buildings with other sensitive receptors). If the noise level at a sensitive receptor's location is more than 10 dB(A) above ambient, MassDEP requires the noise source to mitigate its impact.
- A new noise source will be required to mitigate its sound emissions if they are projected to cause the broadband sound level at a residence or building housing sensitive receptors to exceed ambient background by more than 10 dB(A).
- A new noise source that would be located in an area that is not likely to be developed for residential use in the future (e.g., due to abutting wetlands or similarly undevelopable areas), or in a commercial or industrial area with no sensitive receptors may not be required to mitigate its noise impact on those areas, even if projected to cause noise levels at the facility's property line to exceed ambient background by more than 10 dB(A). However, a new noise source that would be located in an area in which housing or buildings containing other sensitive receptors could be developed in the future may be required to mitigate its noise impact in these areas.


This policy has been designed to protect affected residents and other sensitive occupants of nearby property, but not necessarily uninhabited areas in and around the source's property. Sources of noise may need to implement mitigation if residences or buildings occupied by sensitive receptors are developed where they may be affected by the source's noise.

**Appendix B**

---


**Long-Term Sound Level Measurement Data**

Figure B-1: Baseline Monitoring Graphical Results - LT1  
1-Hour Ambient Sound Level Data

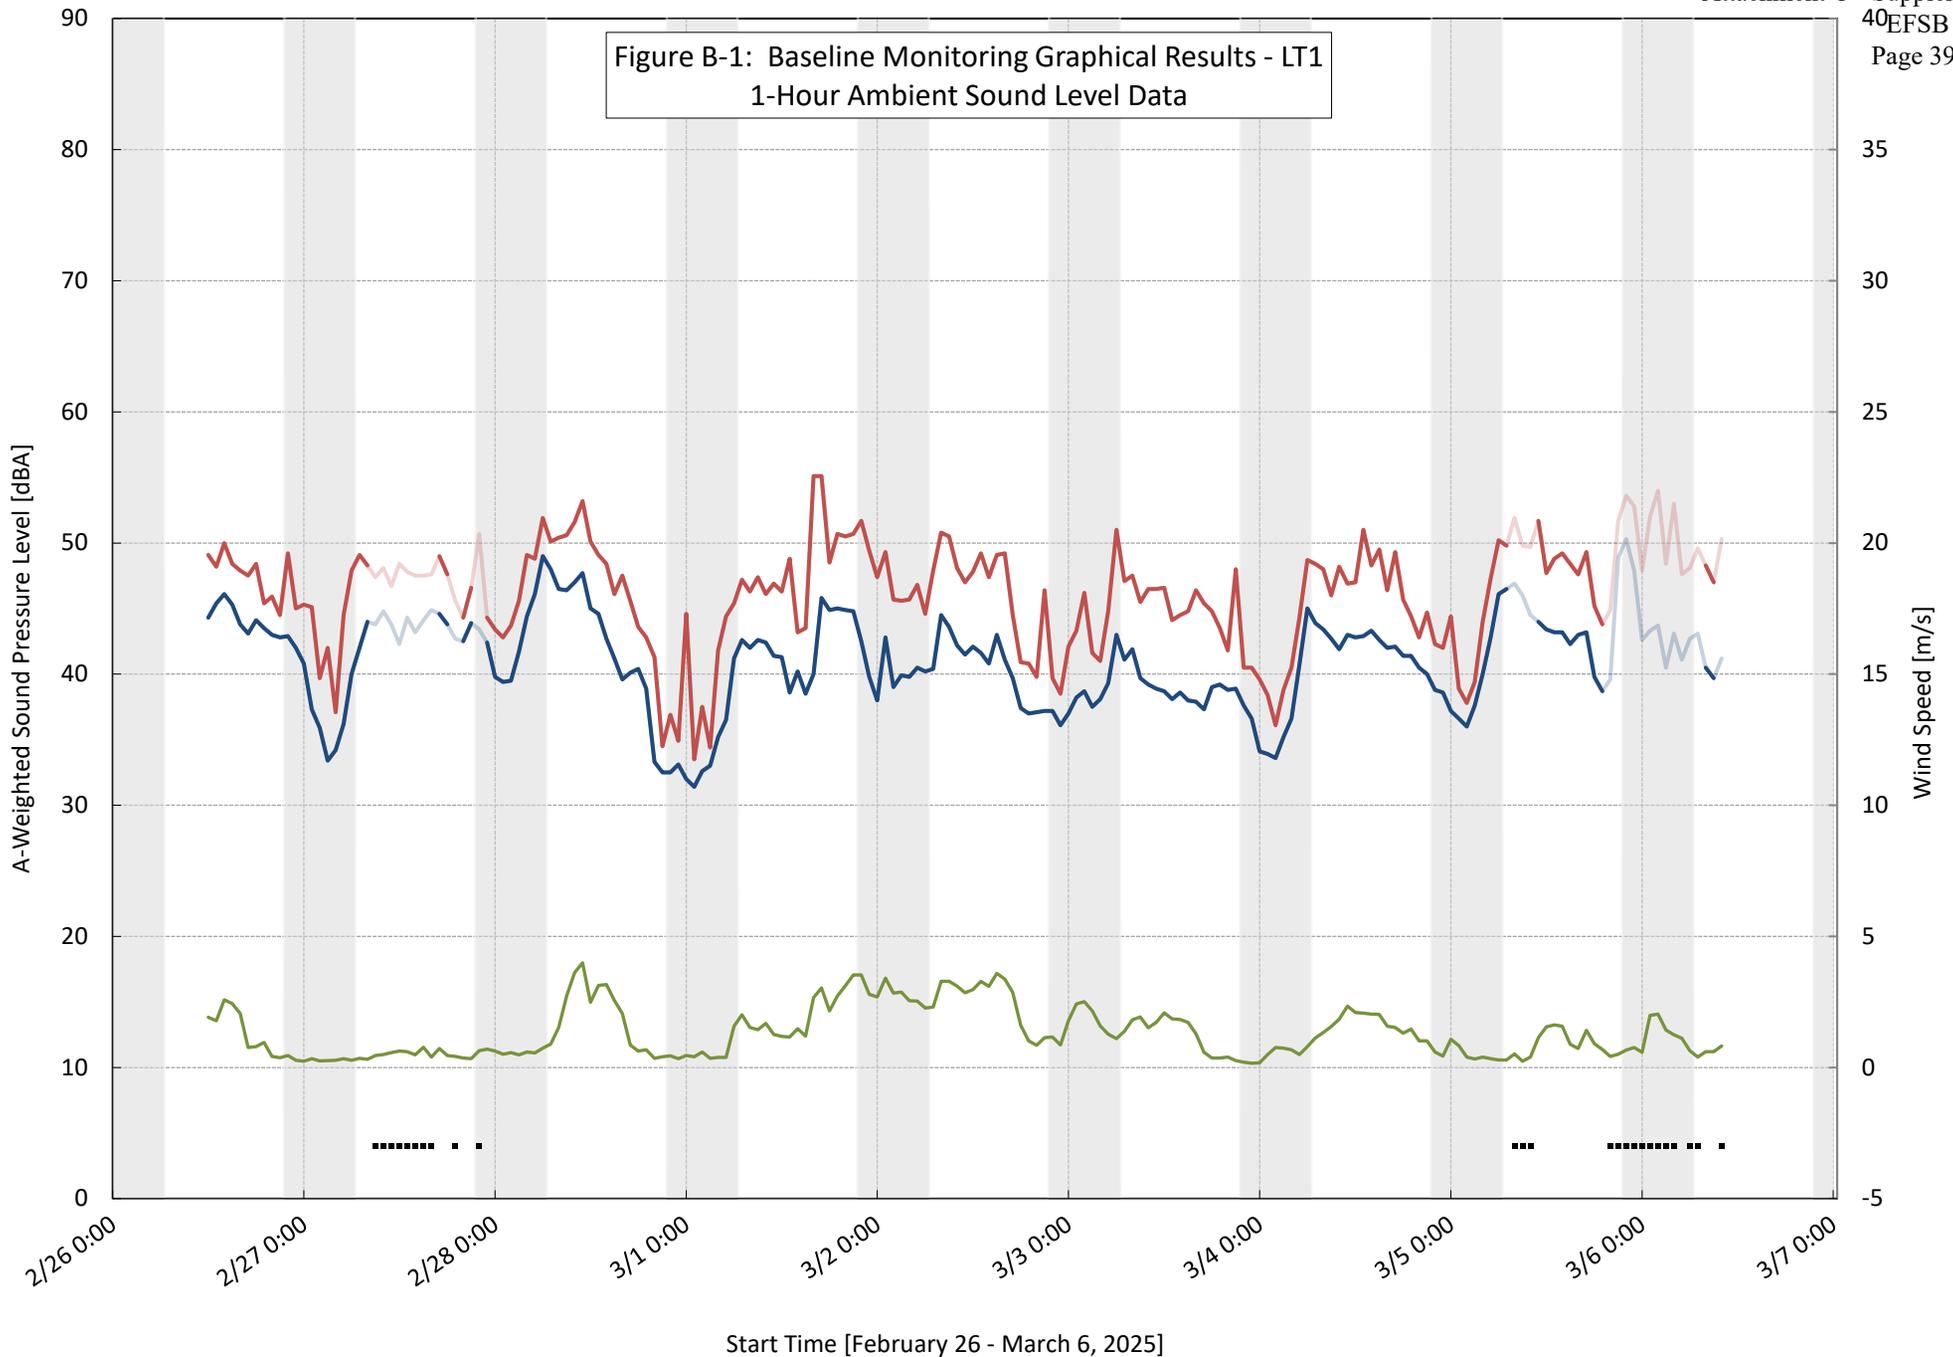


— Leq Measured    — Leq Valid    — L90 Measured    — L90 Valid    ▪ Precipitation    — Ground Level Wind Speed

Figure B-2: Baseline Monitoring Graphical Results - LT2  
1-Hour Ambient Sound Level Data

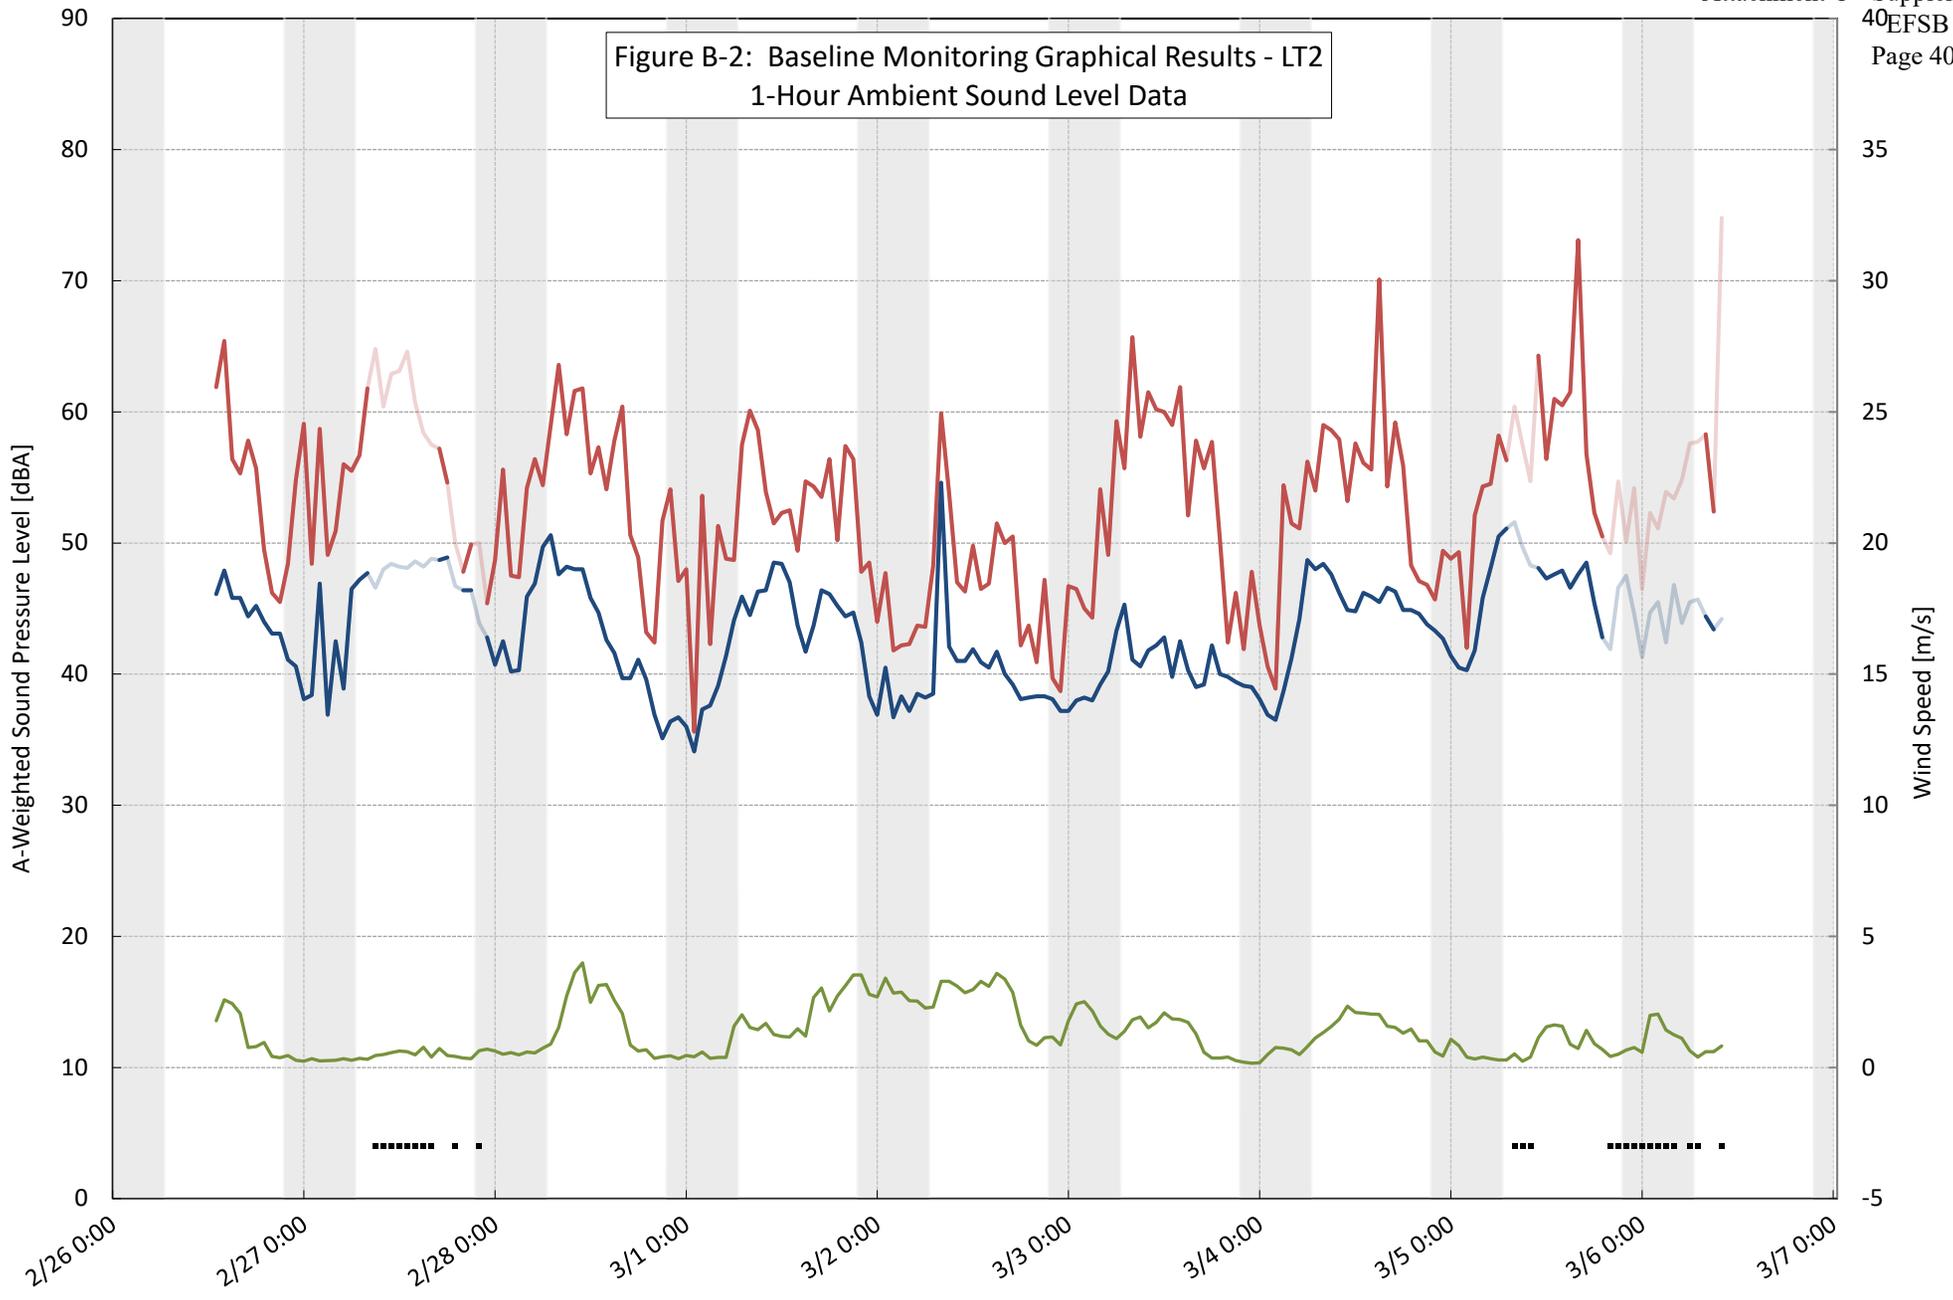

— Leq Measured    — Leq Valid    — L90 Measured    — L90 Valid    ▪ Precipitation    — Ground Level Wind Speed

Figure B-3: Baseline Monitoring Graphical Results - LT3  
1-Hour Ambient Sound Level Data

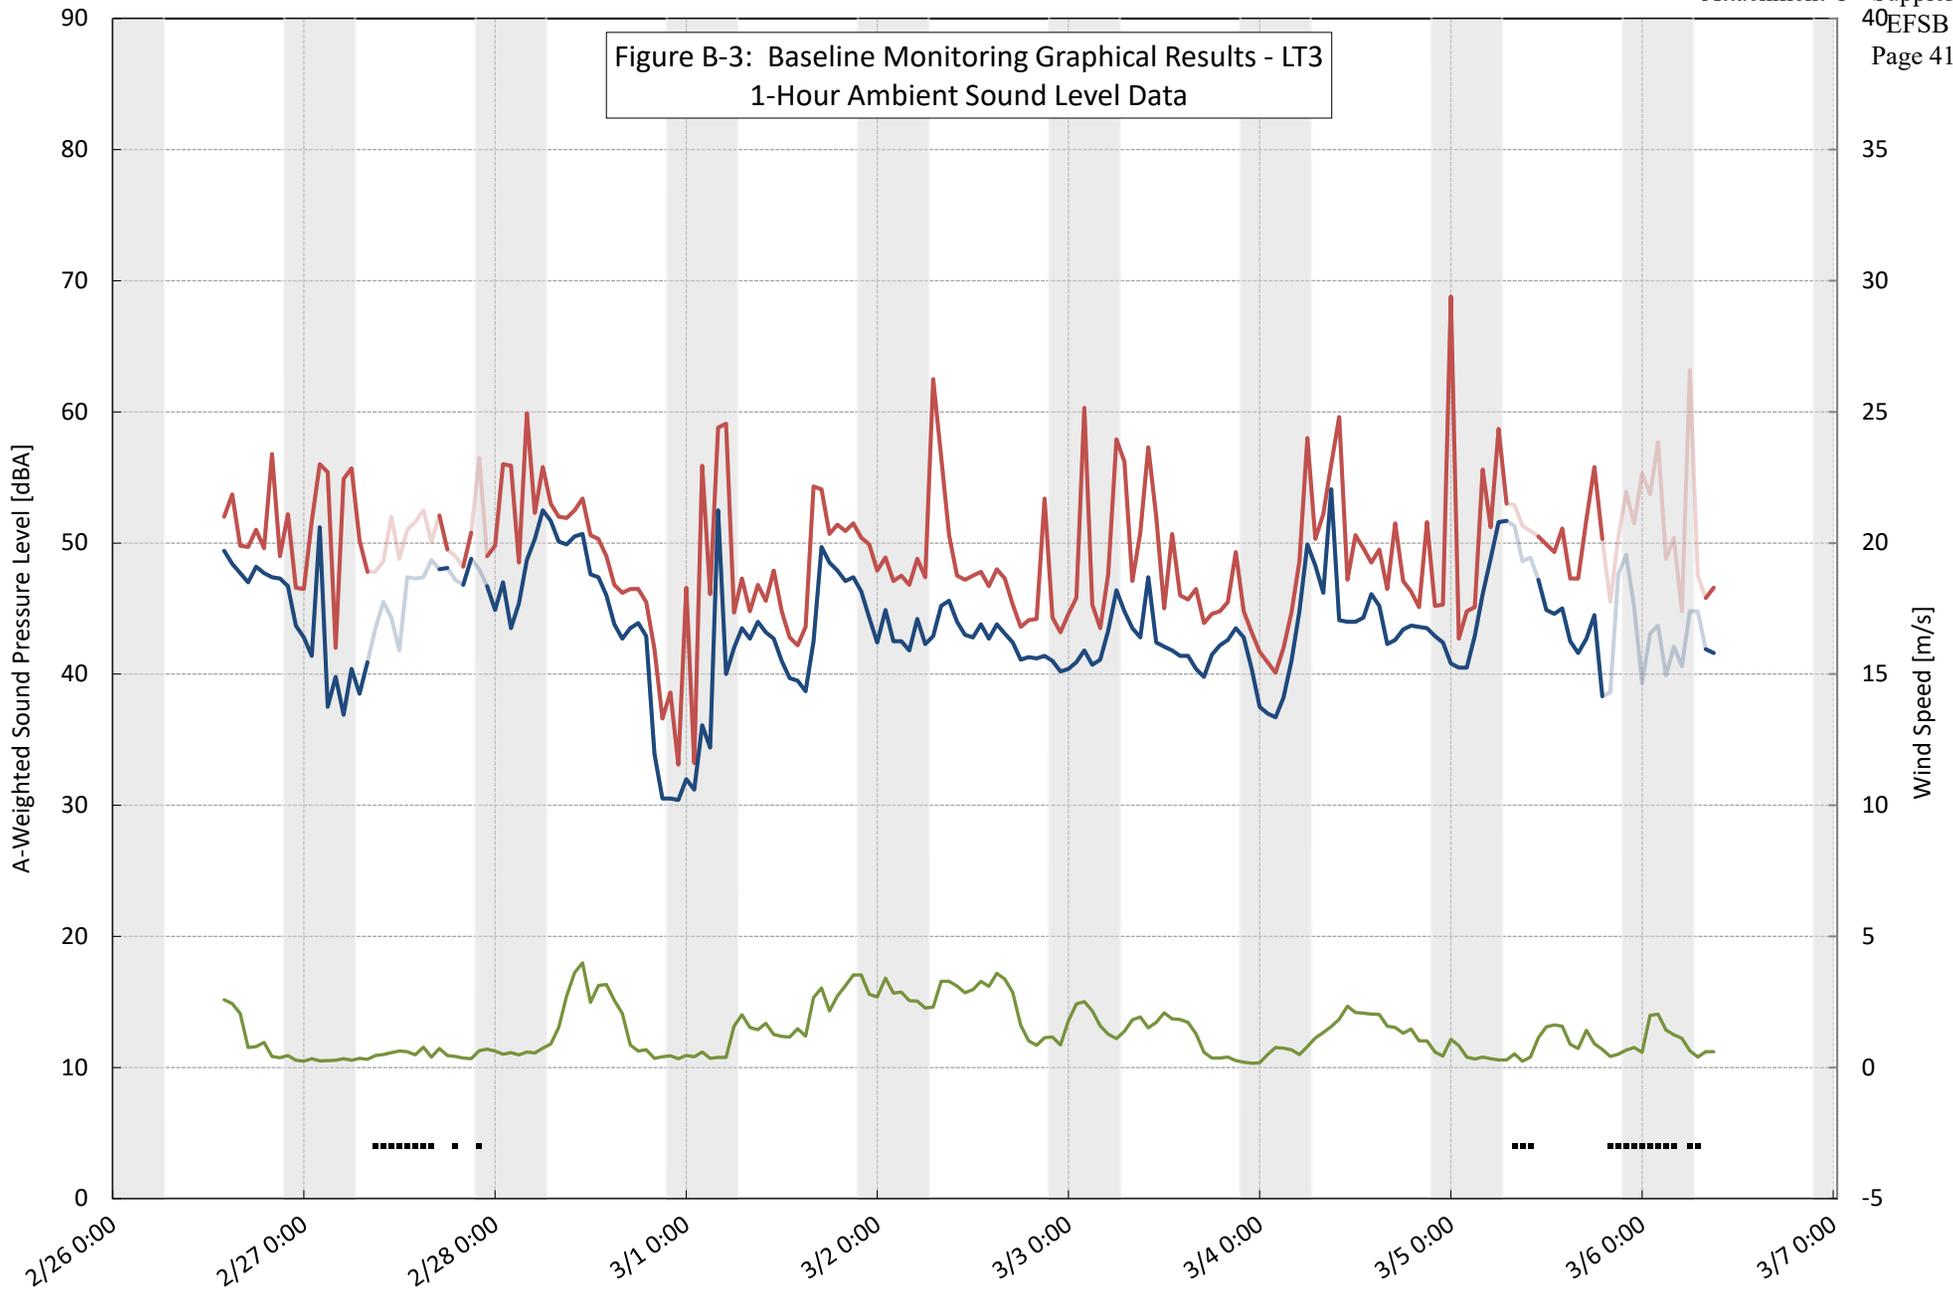

— Leq Measured    — Leq Valid    — L90 Measured    — L90 Valid    ▪ Precipitation    — Ground Level Wind Speed